
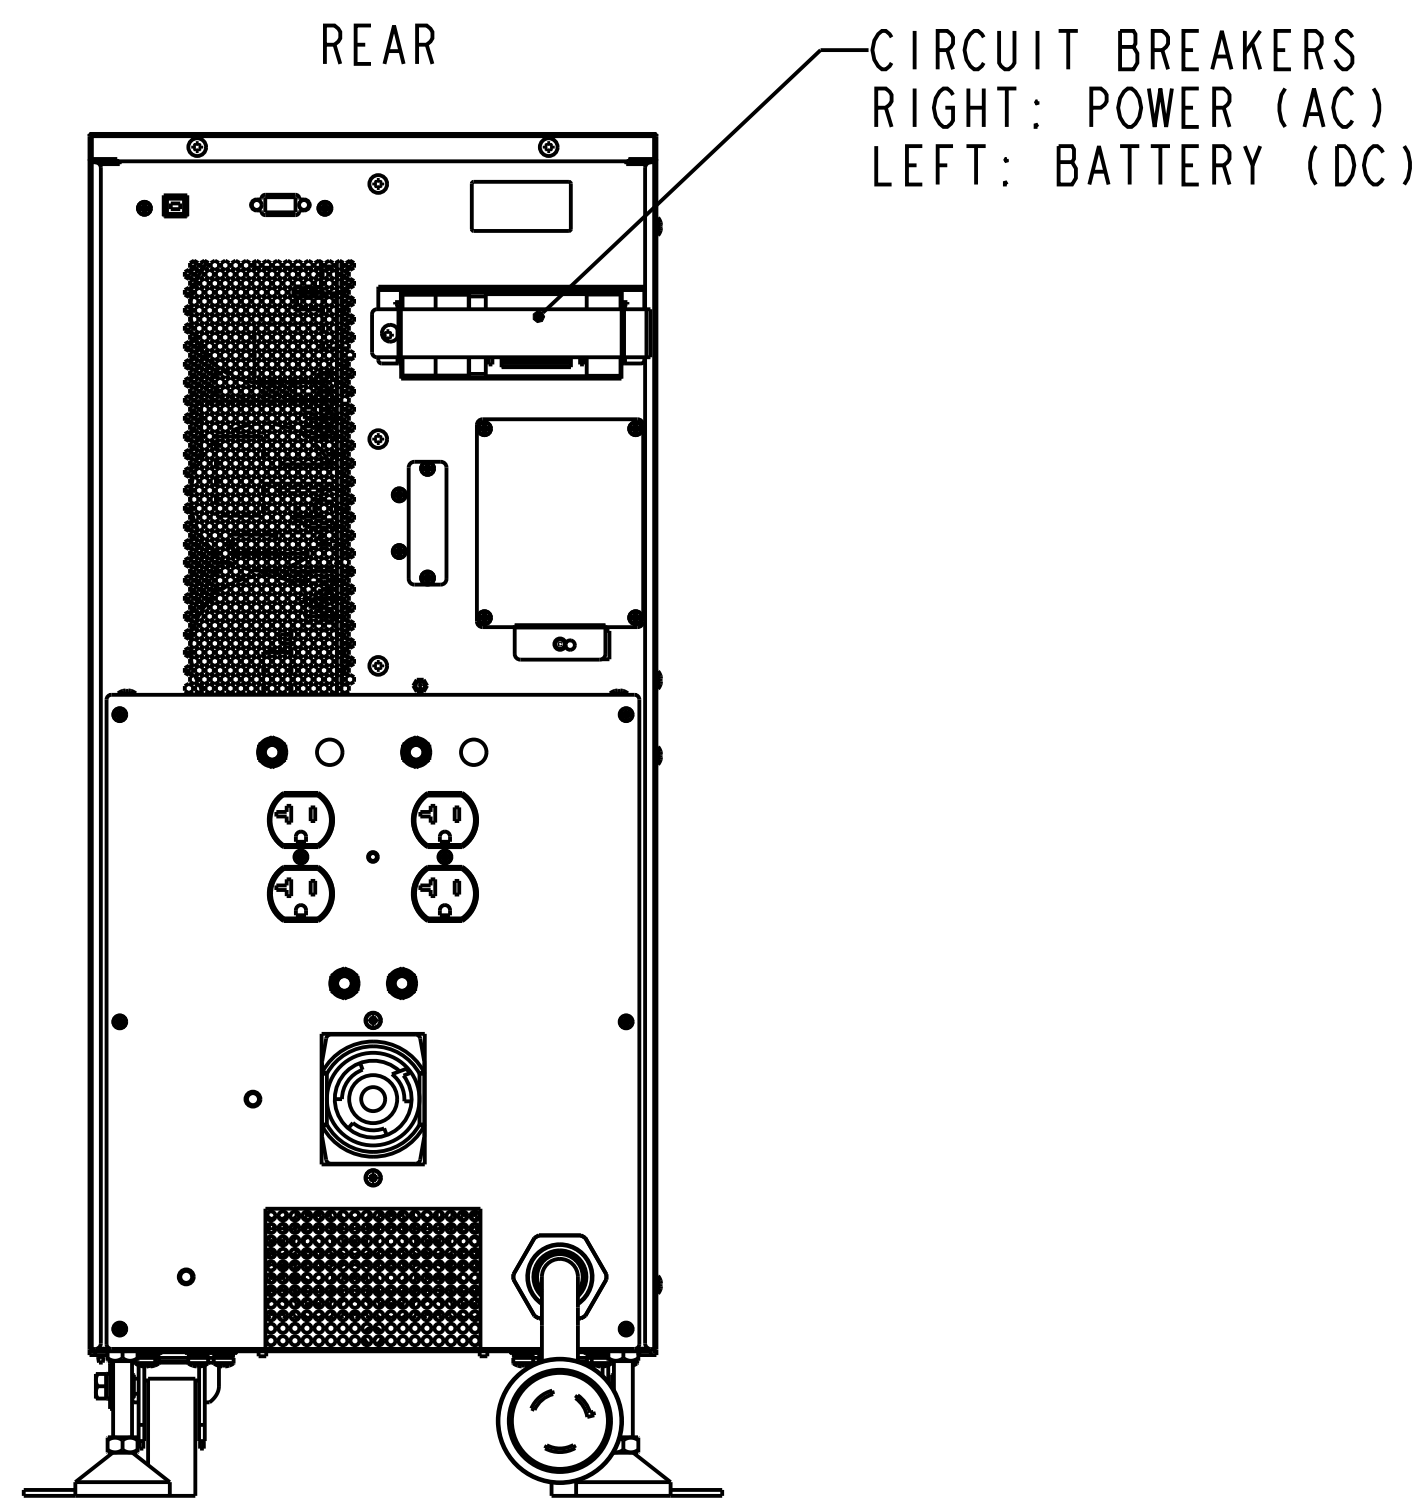
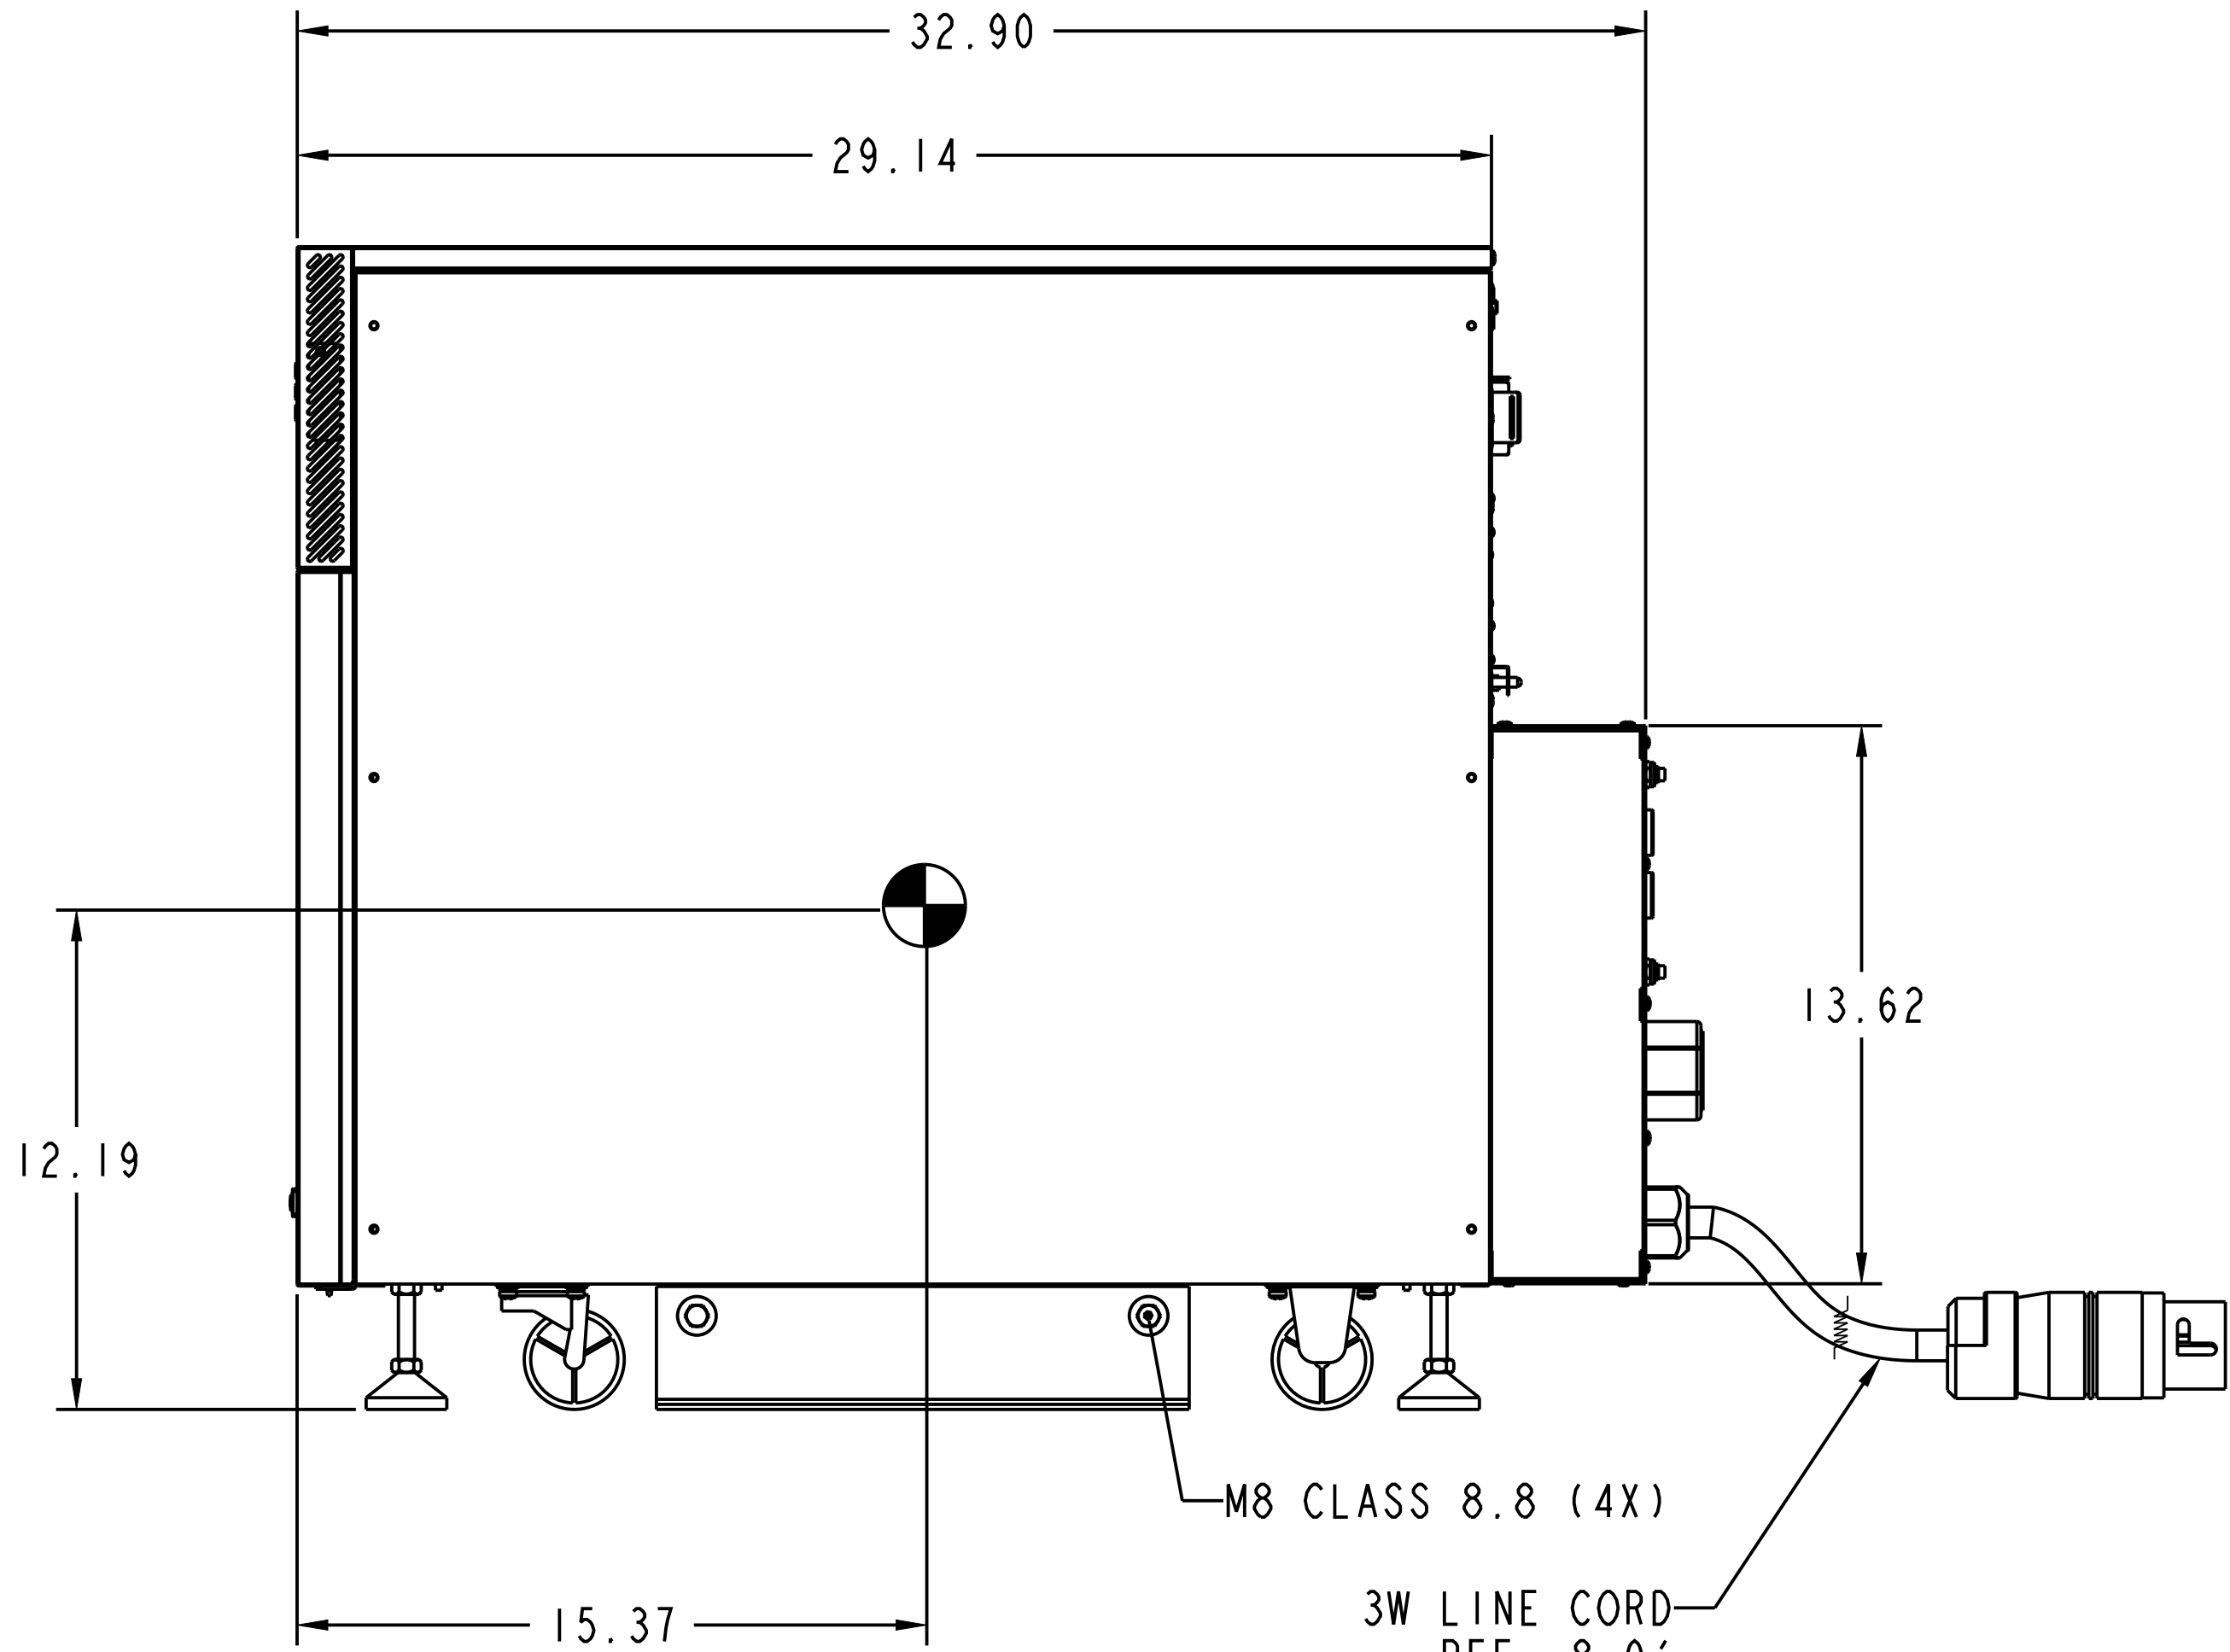
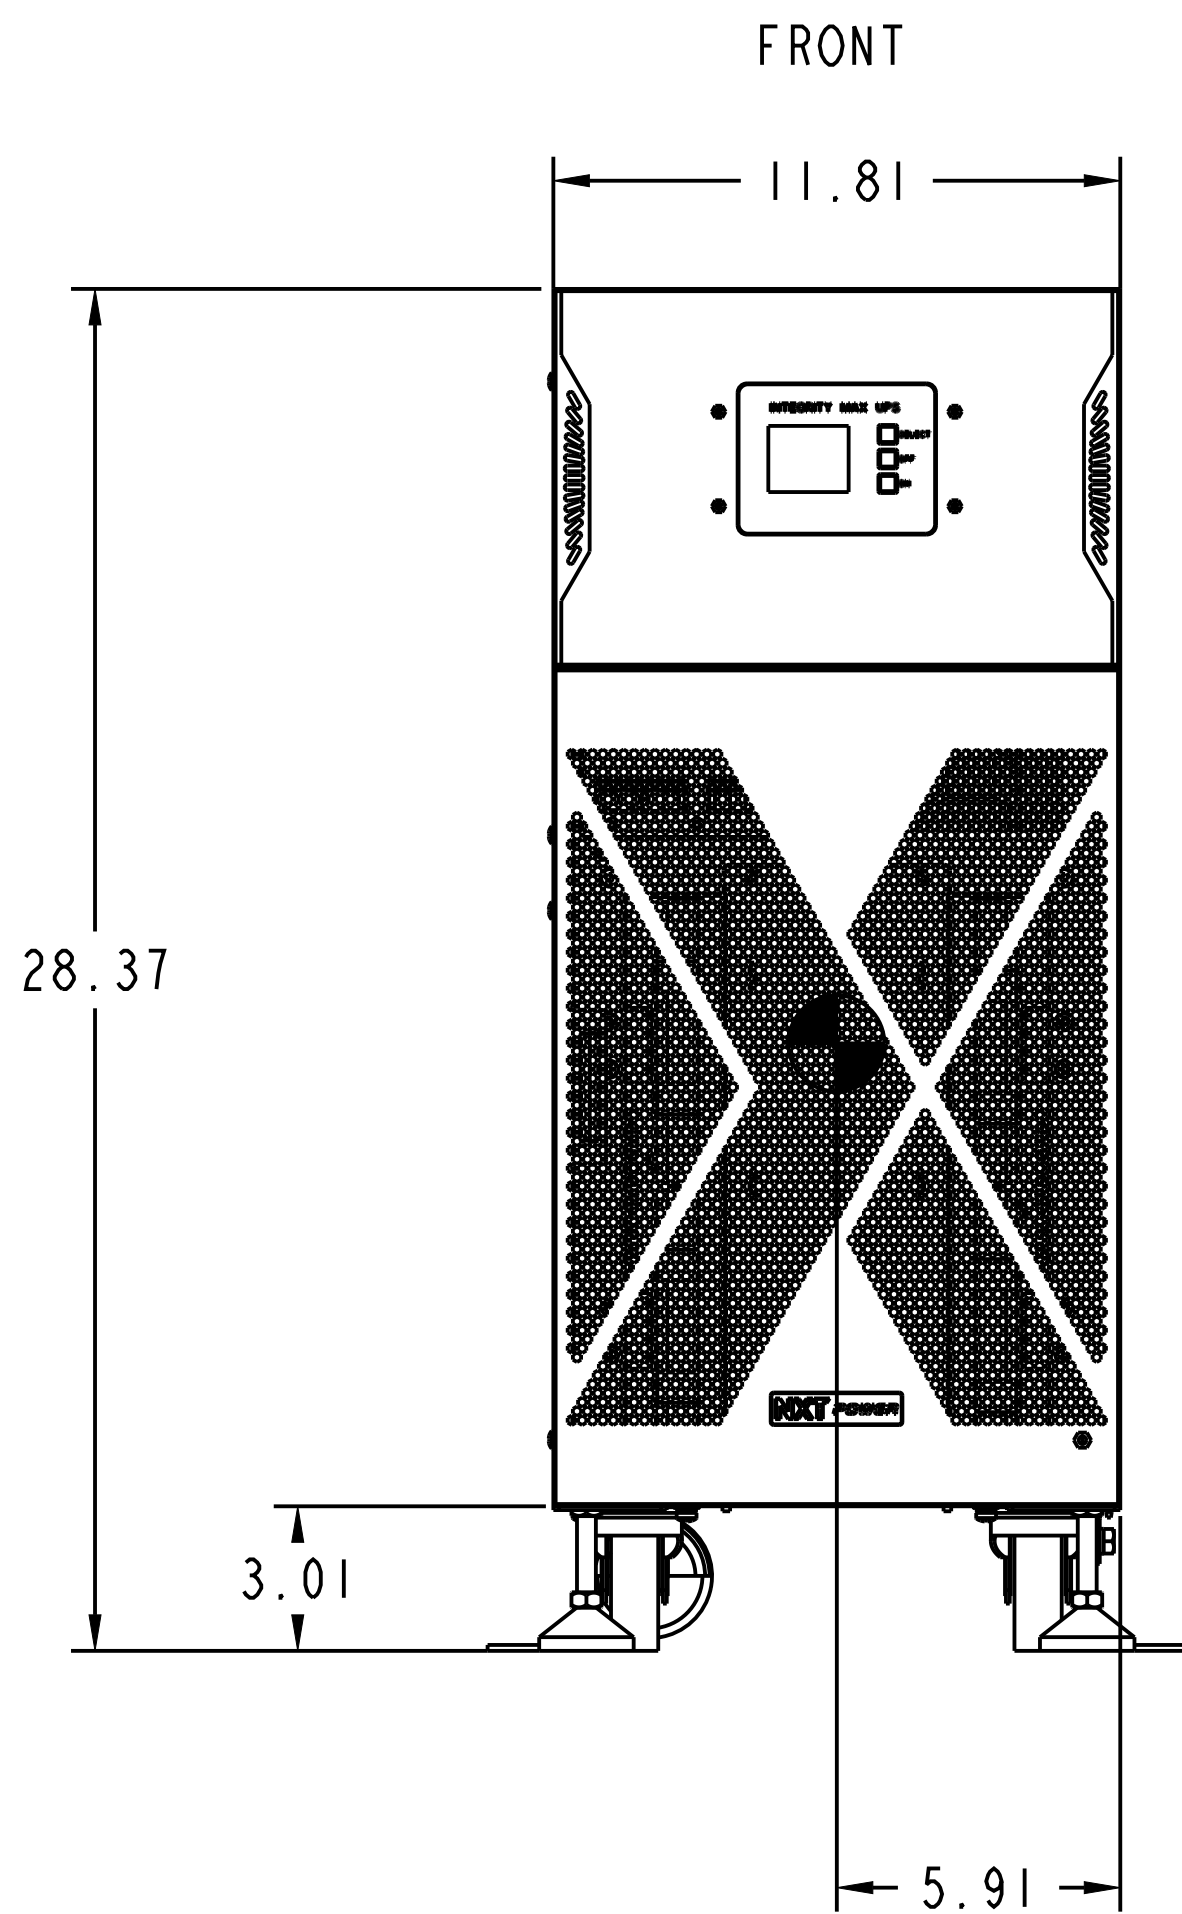


NXT POWER INTEGRITY MAX
NPTU 2.2 - 10.0 KVA ONLINE UPS

⊙ - CENTER OF GRAVITY
UNIT WEIGHT: 350 LBS MAX

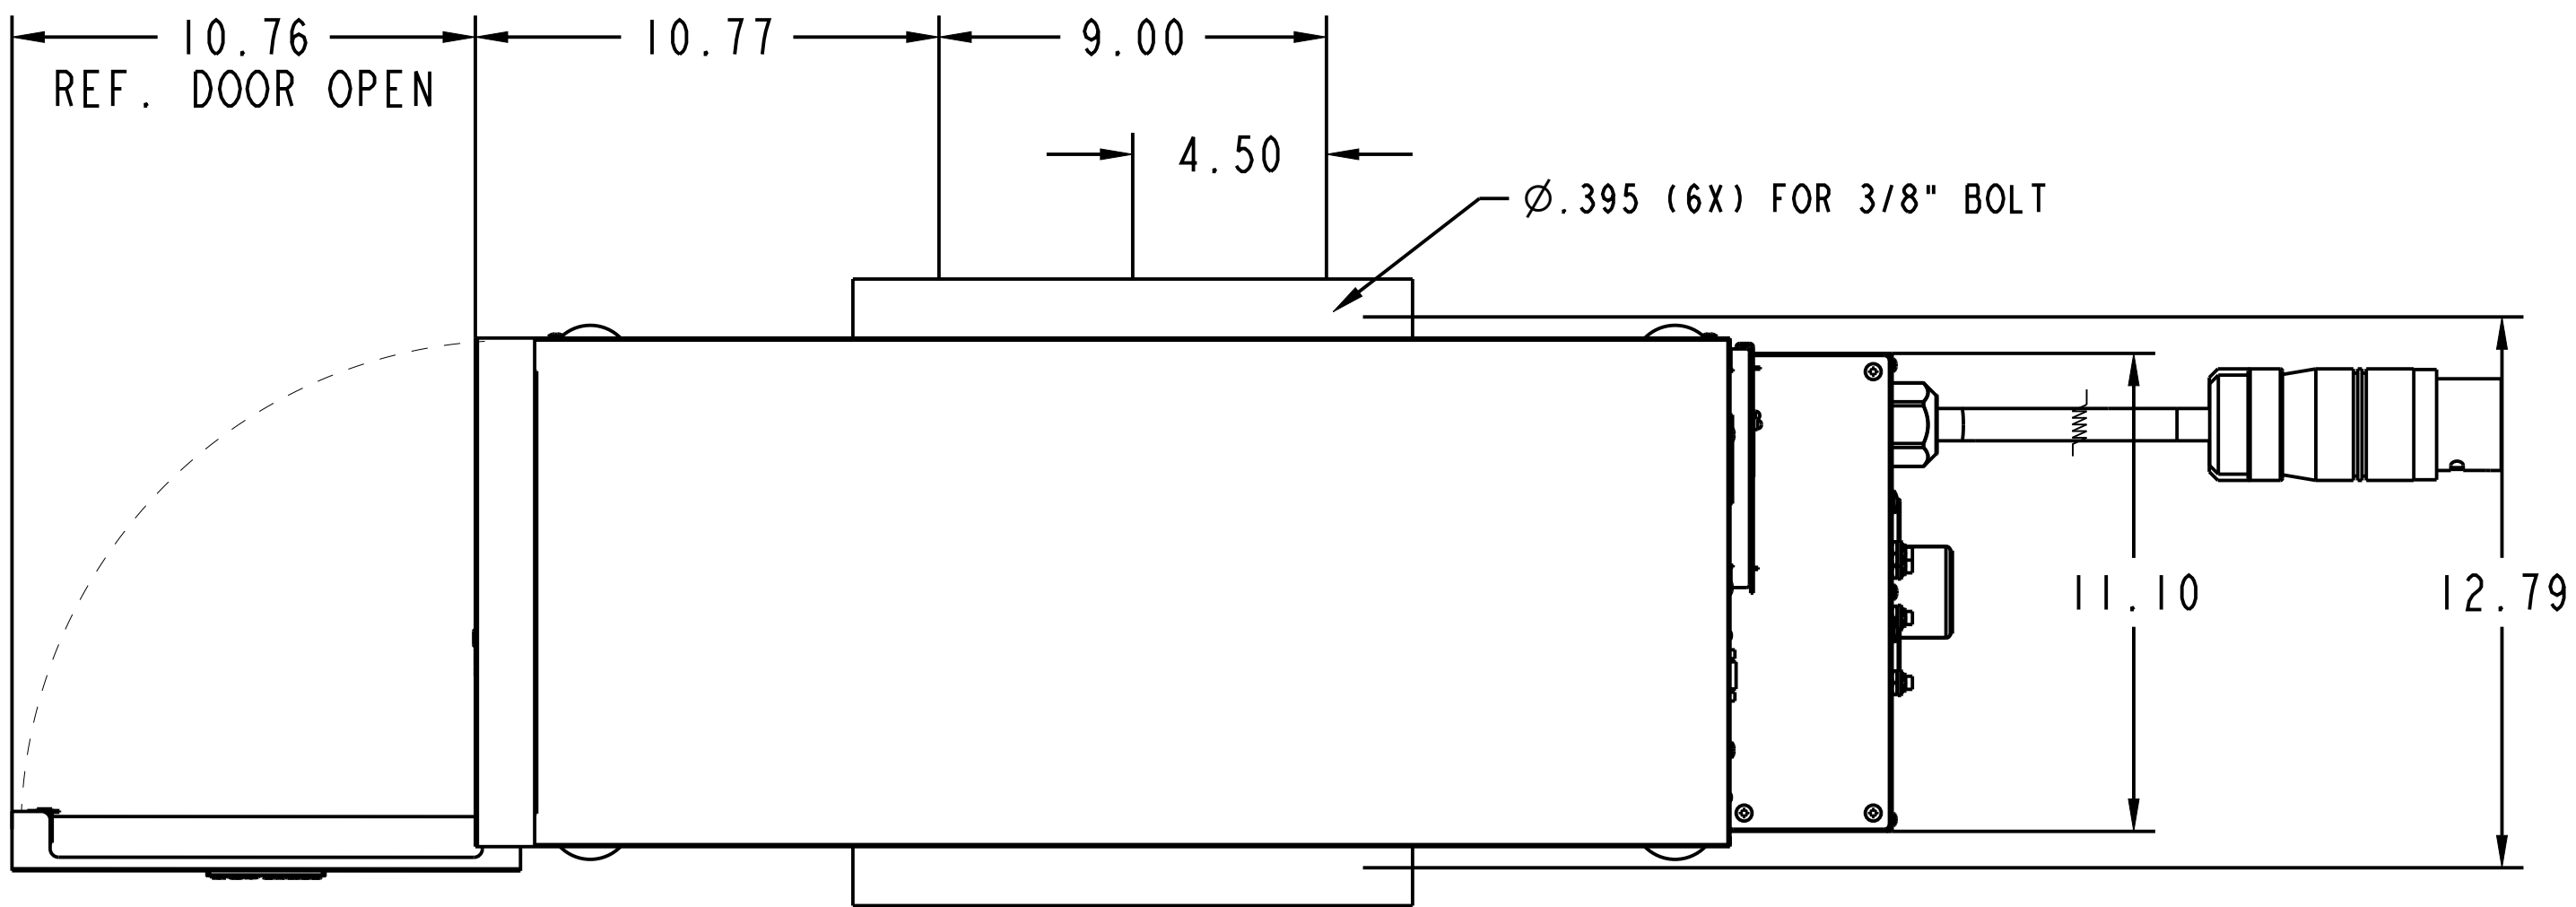

- NOTES:
1. REF 3D CAD DATABASE FOR DIMENSIONAL INQUIRIES
 2. ALL PARTS TO BE FREE FROM SHARP EDGES (DEBURR)
 3. INK STAMP, ETCH, OR STAMP FINISHED PART # AND REV ON INSIDE SURFACE OF PART

UNLESS OTHERWISE SPECIFIED

DIMENSIONS ARE IN DECIMAL INCHES
TOLERANCES
ANGULAR: MACHINED $\pm 0.5^\circ$ BEND $\pm 1^\circ$
ONE PLACE DECIMAL: $\pm .03$
TWO PLACE DECIMAL: $\pm .010$
THREE PLACE DECIMAL: $\pm .005$
BREAK SHARP EDGES: .01-.02R

NXT POWER PART NO. NPTU 2.2-10.0 KVA

DESCRIPTION: INTEGRITY MAX NPTU 2.2-10.0 KVA
SEISMIC ANCHORAGE SPECS

INITIATOR: BRO

REVISION: A

MATERIAL: NA

FINISH: NA

SIZE: D

SCALE: 0.143

PAGE: 1 of 3


NPTU 2.2-10.0 KVA
SEISMIC ANCHORAGE
SLAB ON GRADE

BOLT TORQUE SPEC:
3NM / 27 IN LBS
UNIT WEIGHT: 350 LBS MAX

INTEGRITY MAX SEISMIC ANCHORING INSTRUCTIONS:

1) MOVE THE UPS TO THE INSTALLATION LOCATION
2) ATTACH UPS SEISMIC ANCHORS (2X) NXT PART NUMBER 001-00021-01-FNL
USING M8 CLASS 8.8 BOLTS AND WASHERS (4X) AND TORQUE TO 27 IN LBS.
THESE BOLTS AND WASHERS ARE PROVIDED AND INSTALLED WITH SHIPPING BRACKETS OF THE UPS.
3) BOLT THE UPS TO THE FLOOR USING 3/8" GRADE 8 EXPANSION ANCHORS (6X) FOR CONCRETE AS DESCRIBED BELOW.

REV	ECN	CHANGE DESCRIPTION	ENGINEER	DATE	APPROVED
A			BRO	Nov-14-22	

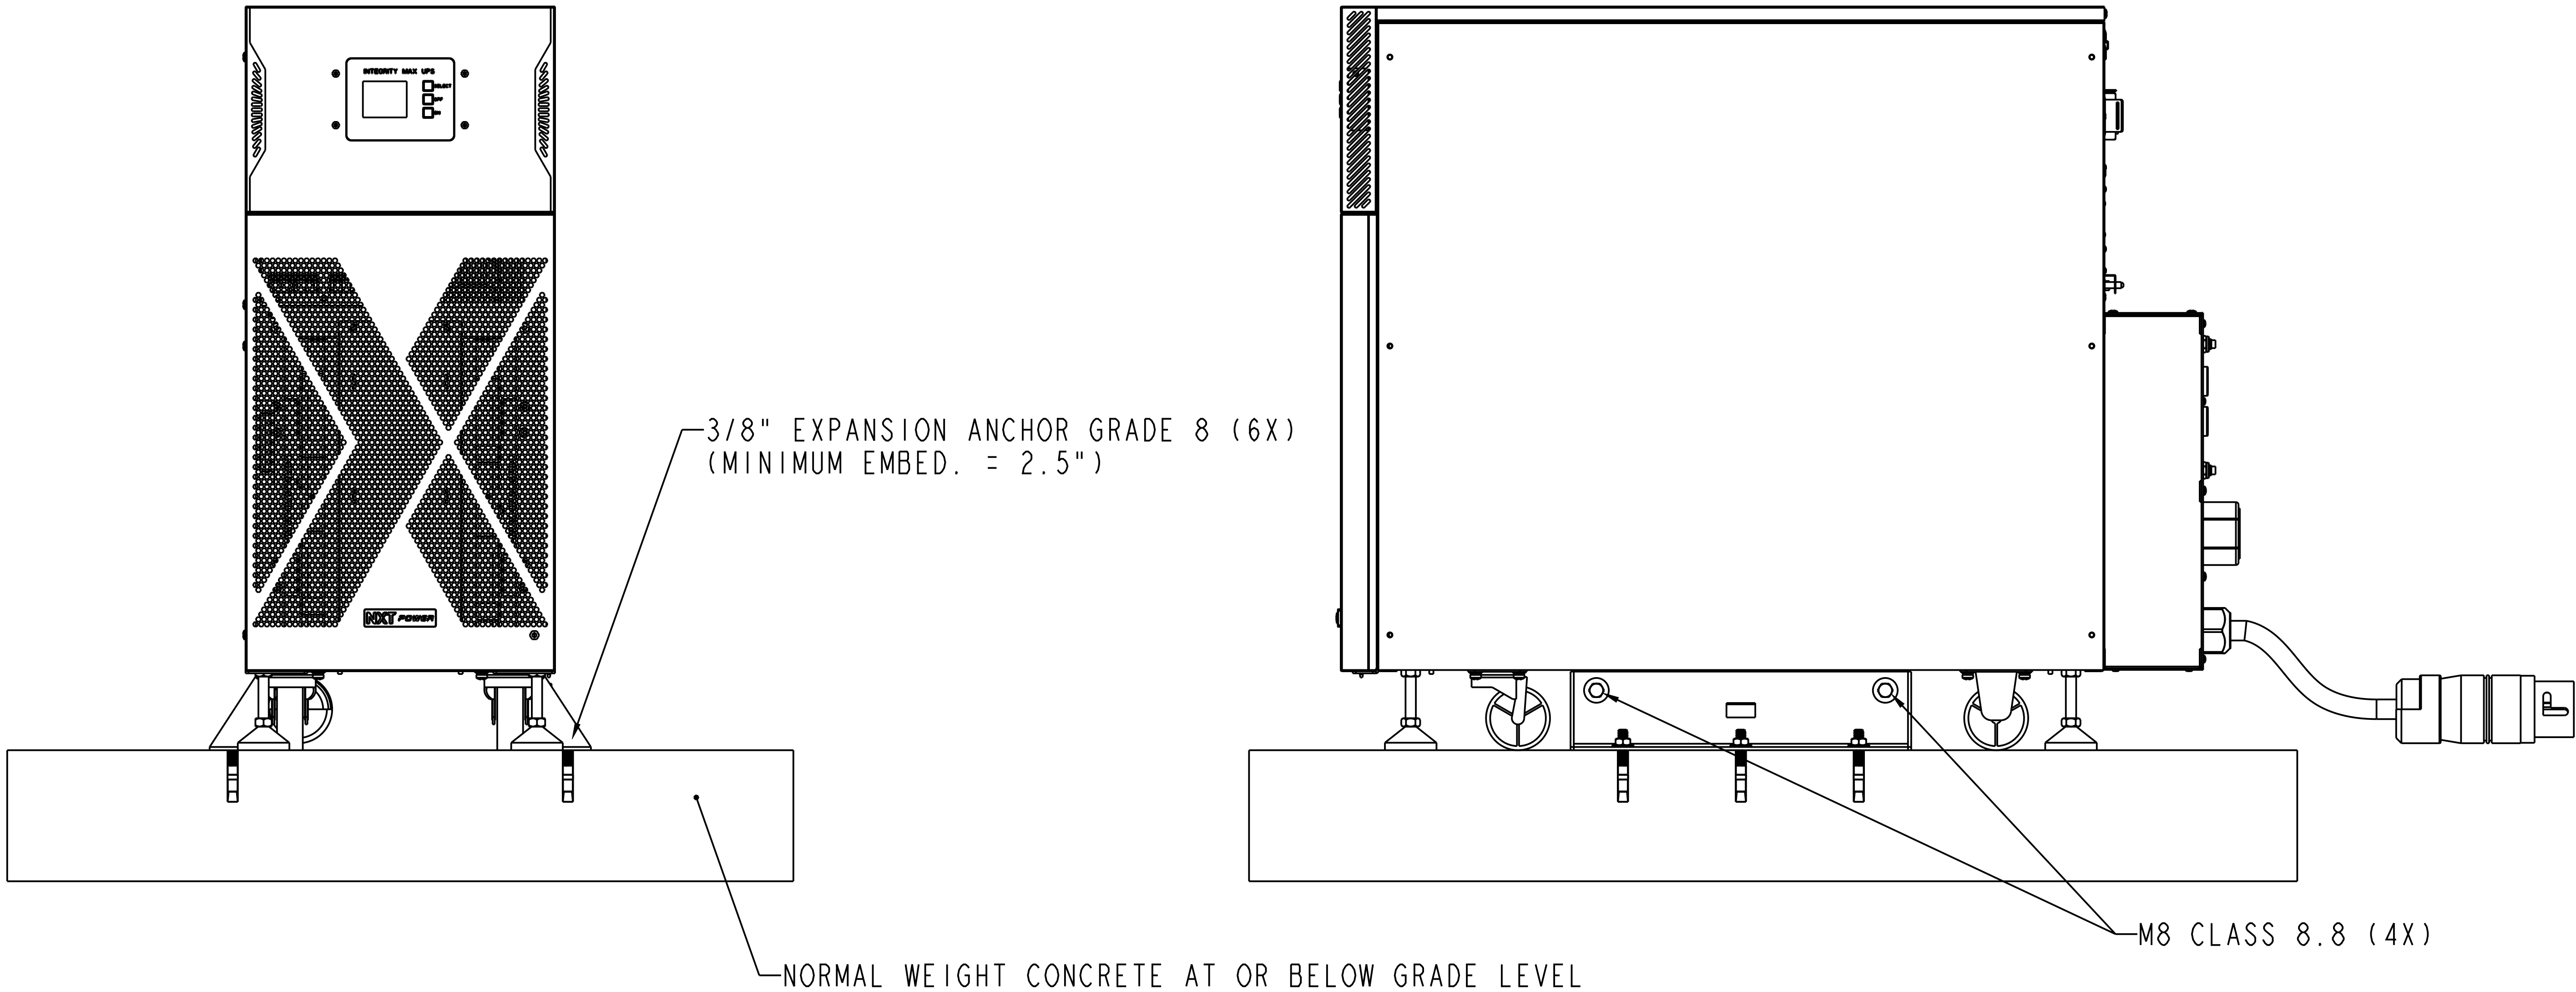


UNLESS OTHERWISE SPECIFIED					
DIMENSIONS ARE IN DECIMAL INCHES		NXT POWER PART NO. NPTU 2.2-10.0 KVA		MATERIAL:	
TOLERANCES		DESCRIPTION: INTEGRITY MAX NPTU 2.2-10.0 KVA		FINISH:	
ANGULAR: MACHINED ±0.5° BEND ± 1°		SEISMIC ANCHORAGE SPECS		SIZE: D	
ONE PLACE DECIMAL: ±.03		INITIATOR: BRO	REVISION: A	SCALE: 0.125	PAGE: 2 of 3
TWO PLACE DECIMAL: ±.010					
THREE PLACE DECIMAL: ±.005					
BREAK SHARP EDGES: .01-.02R					

NPTU 2.2-10.0 KVA
SEISMIC ANCHORAGE
UPPER FLOOR

BOLT TORQUE SPEC:
3NM / 27 IN LBS
UNIT WEIGHT: 350 LBS MAX

- INTEGRITY MAX SEISMIC ANCHORING INSTRUCTIONS:
- 1) MOVE THE UPS TO THE INSTALLATION LOCATION
 - 2) ATTACH UPS SEISMIC ANCHORS (2X) NXT PART NUMBER 001-00021-01-FNL USING M8 CLASS 8.8 BOLTS AND WASHERS (4X) AND TORQUE TO 27 IN LBS. THESE BOLTS AND WASHERS ARE PROVIDED AND INSTALLED WITH SHIPPING BRACKETS OF THE UPS.
 - 3) BOLT THE UPS TO THE FLOOR USING 3/8" GRADE 8 EXPANSION ANCHORS (6X) FOR CONCRETE AS DESCRIBED BELOW.

REV	ECN	CHANGE DESCRIPTION	ENGINEER	DATE	APPROVED
A			BRO	Nov-14-22	

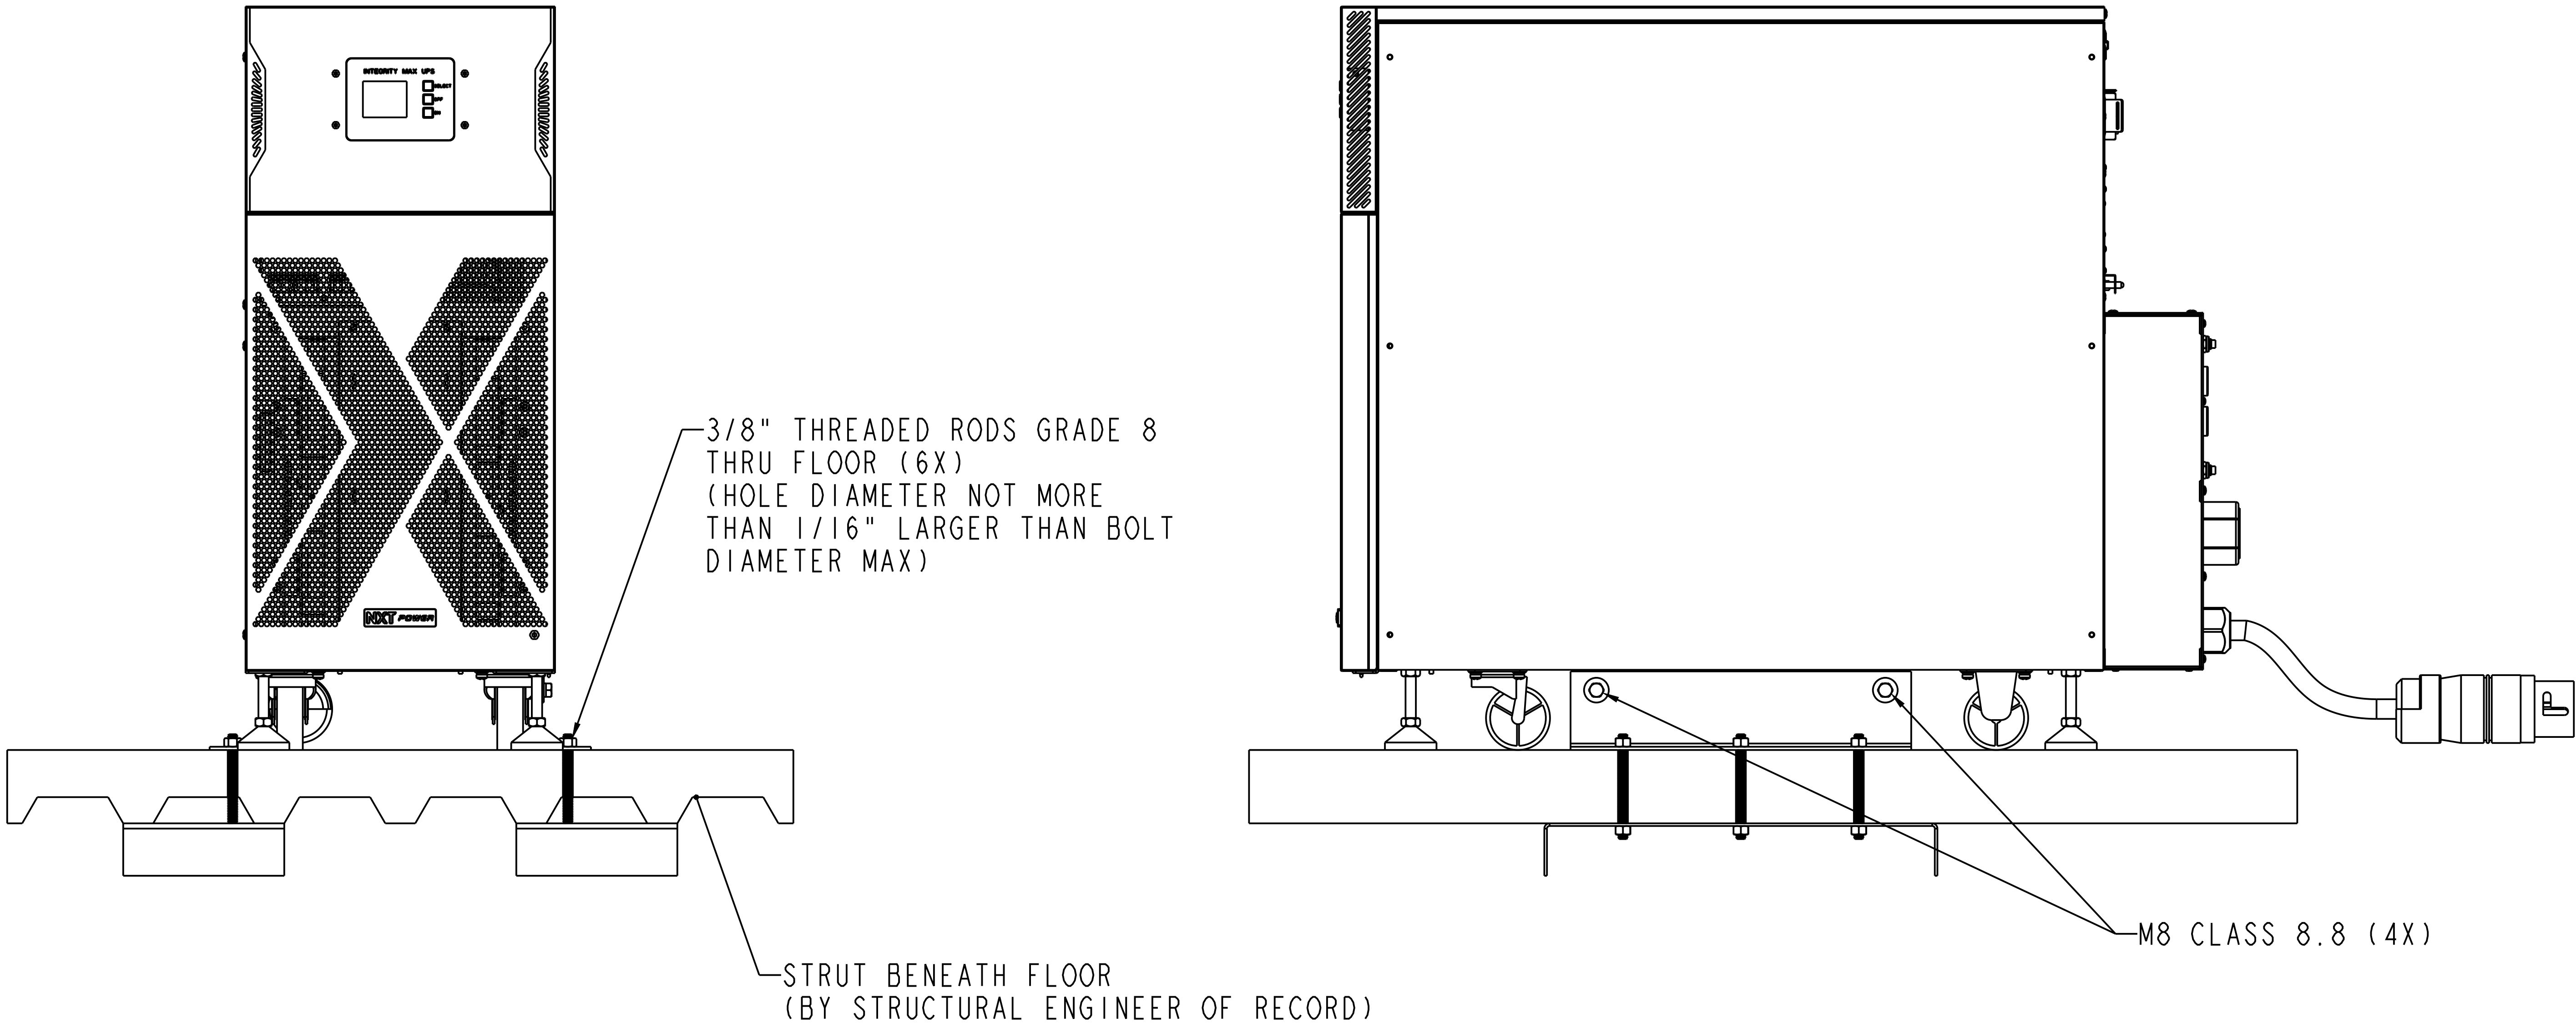

UNLESS OTHERWISE SPECIFIED		NXT POWER			
DIMENSIONS ARE IN DECIMAL INCHES		NXT POWER PART NO. NPTU 2.2-10.0 KVA		MATERIAL:	
TOLERANCES		DESCRIPTION: INTEGRITY MAX NPTU 2.2-10.0 KVA		FINISH:	
ANGULAR: MACHINED ±0.5° BEND ± 1°		SEISMIC ANCHORAGE SPECS		SIZE: D	
ONE PLACE DECIMAL: ±.03		INITIATOR: BRO	REVISION: A	SCALE: 0.125	PAGE: 3 of 3
TWO PLACE DECIMAL: ±.010					
THREE PLACE DECIMAL: ±.005					
BREAK SHARP EDGES: .01-.02R					