
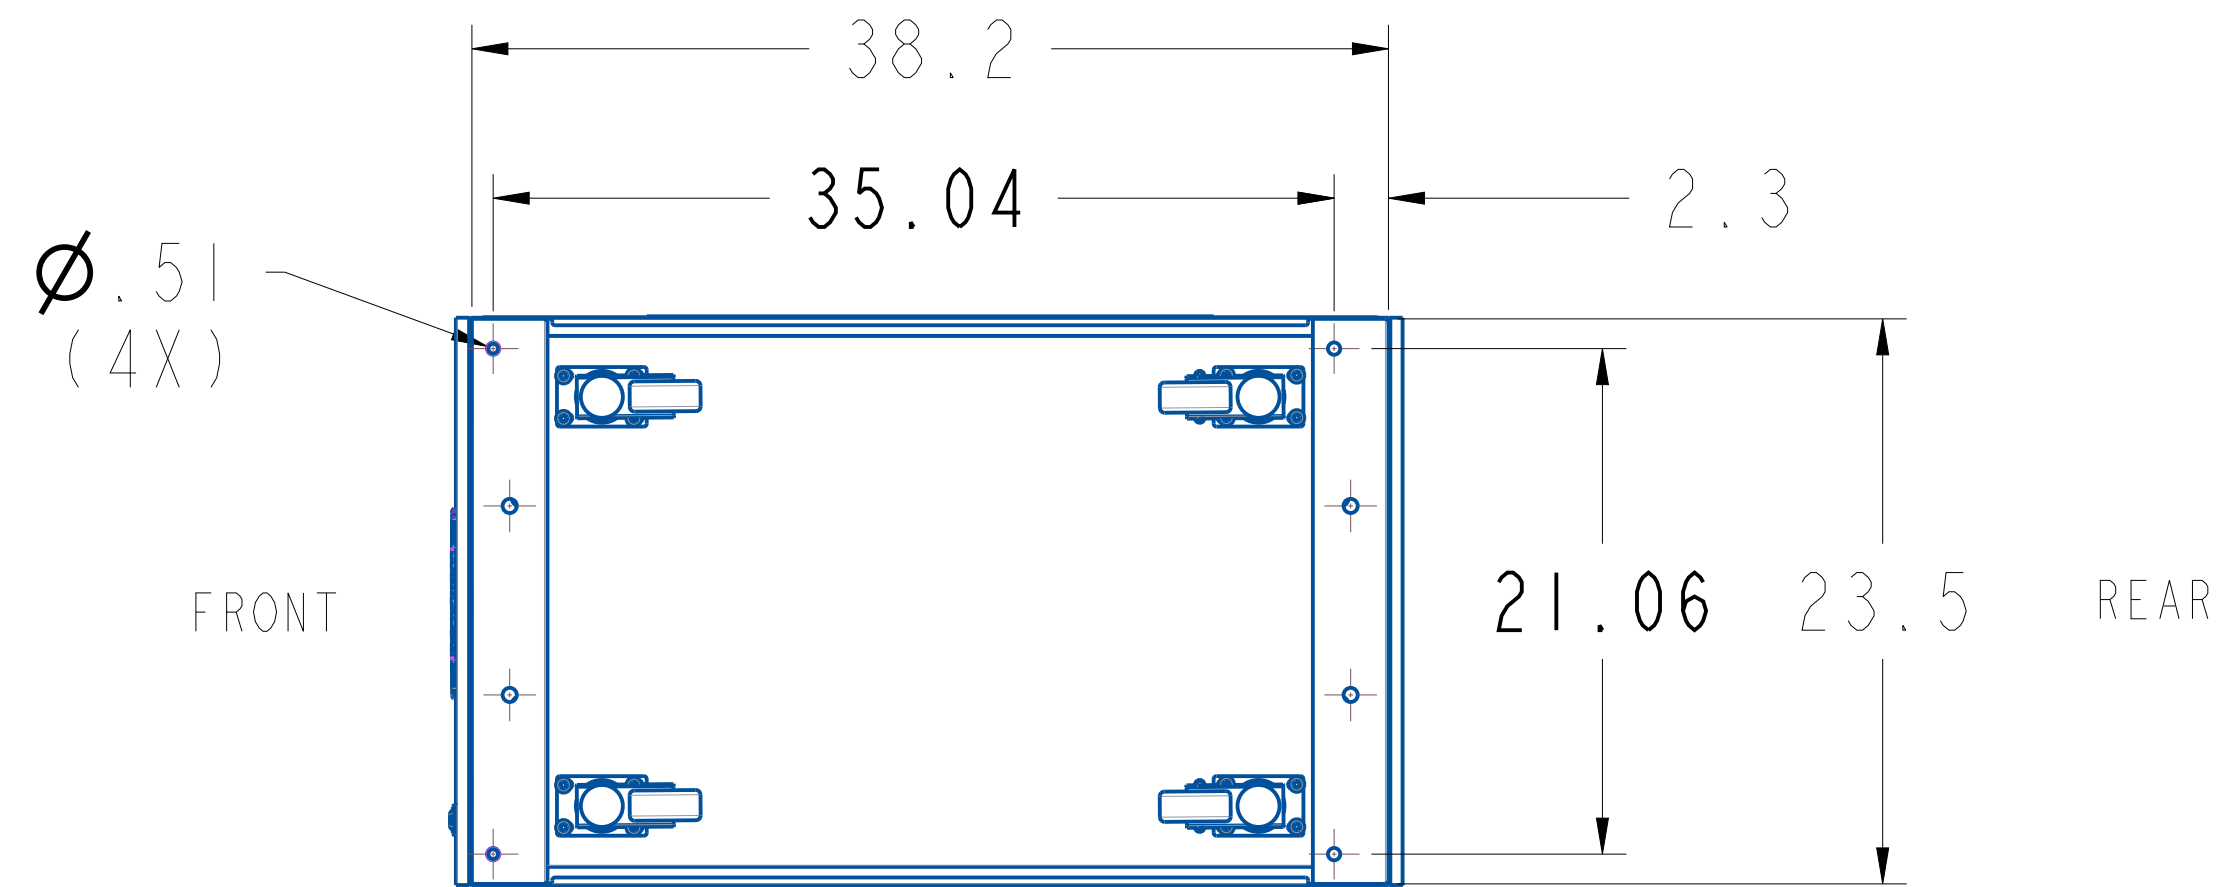
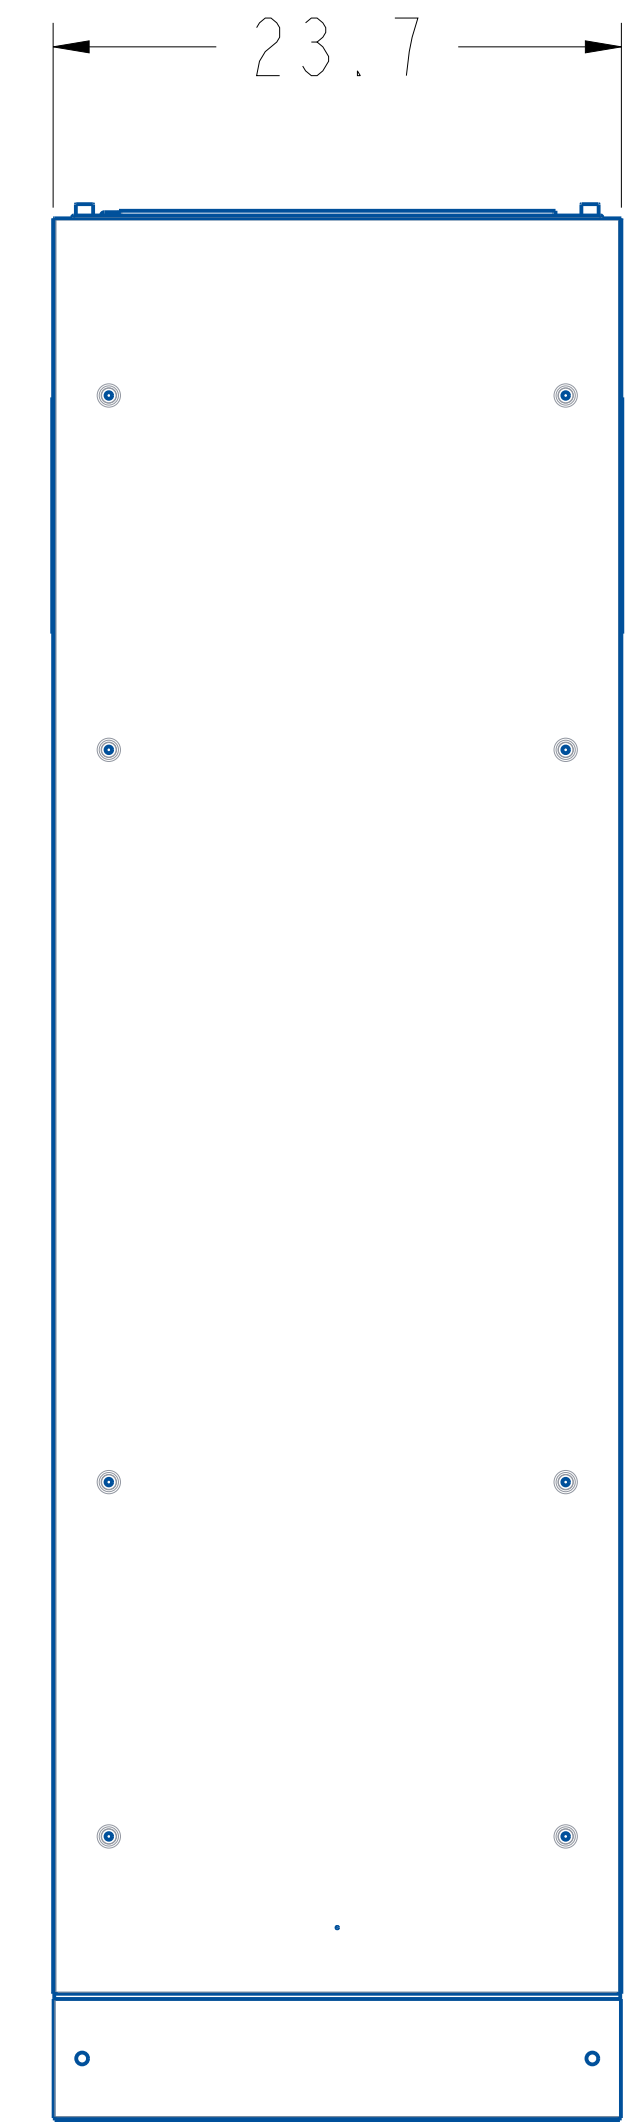
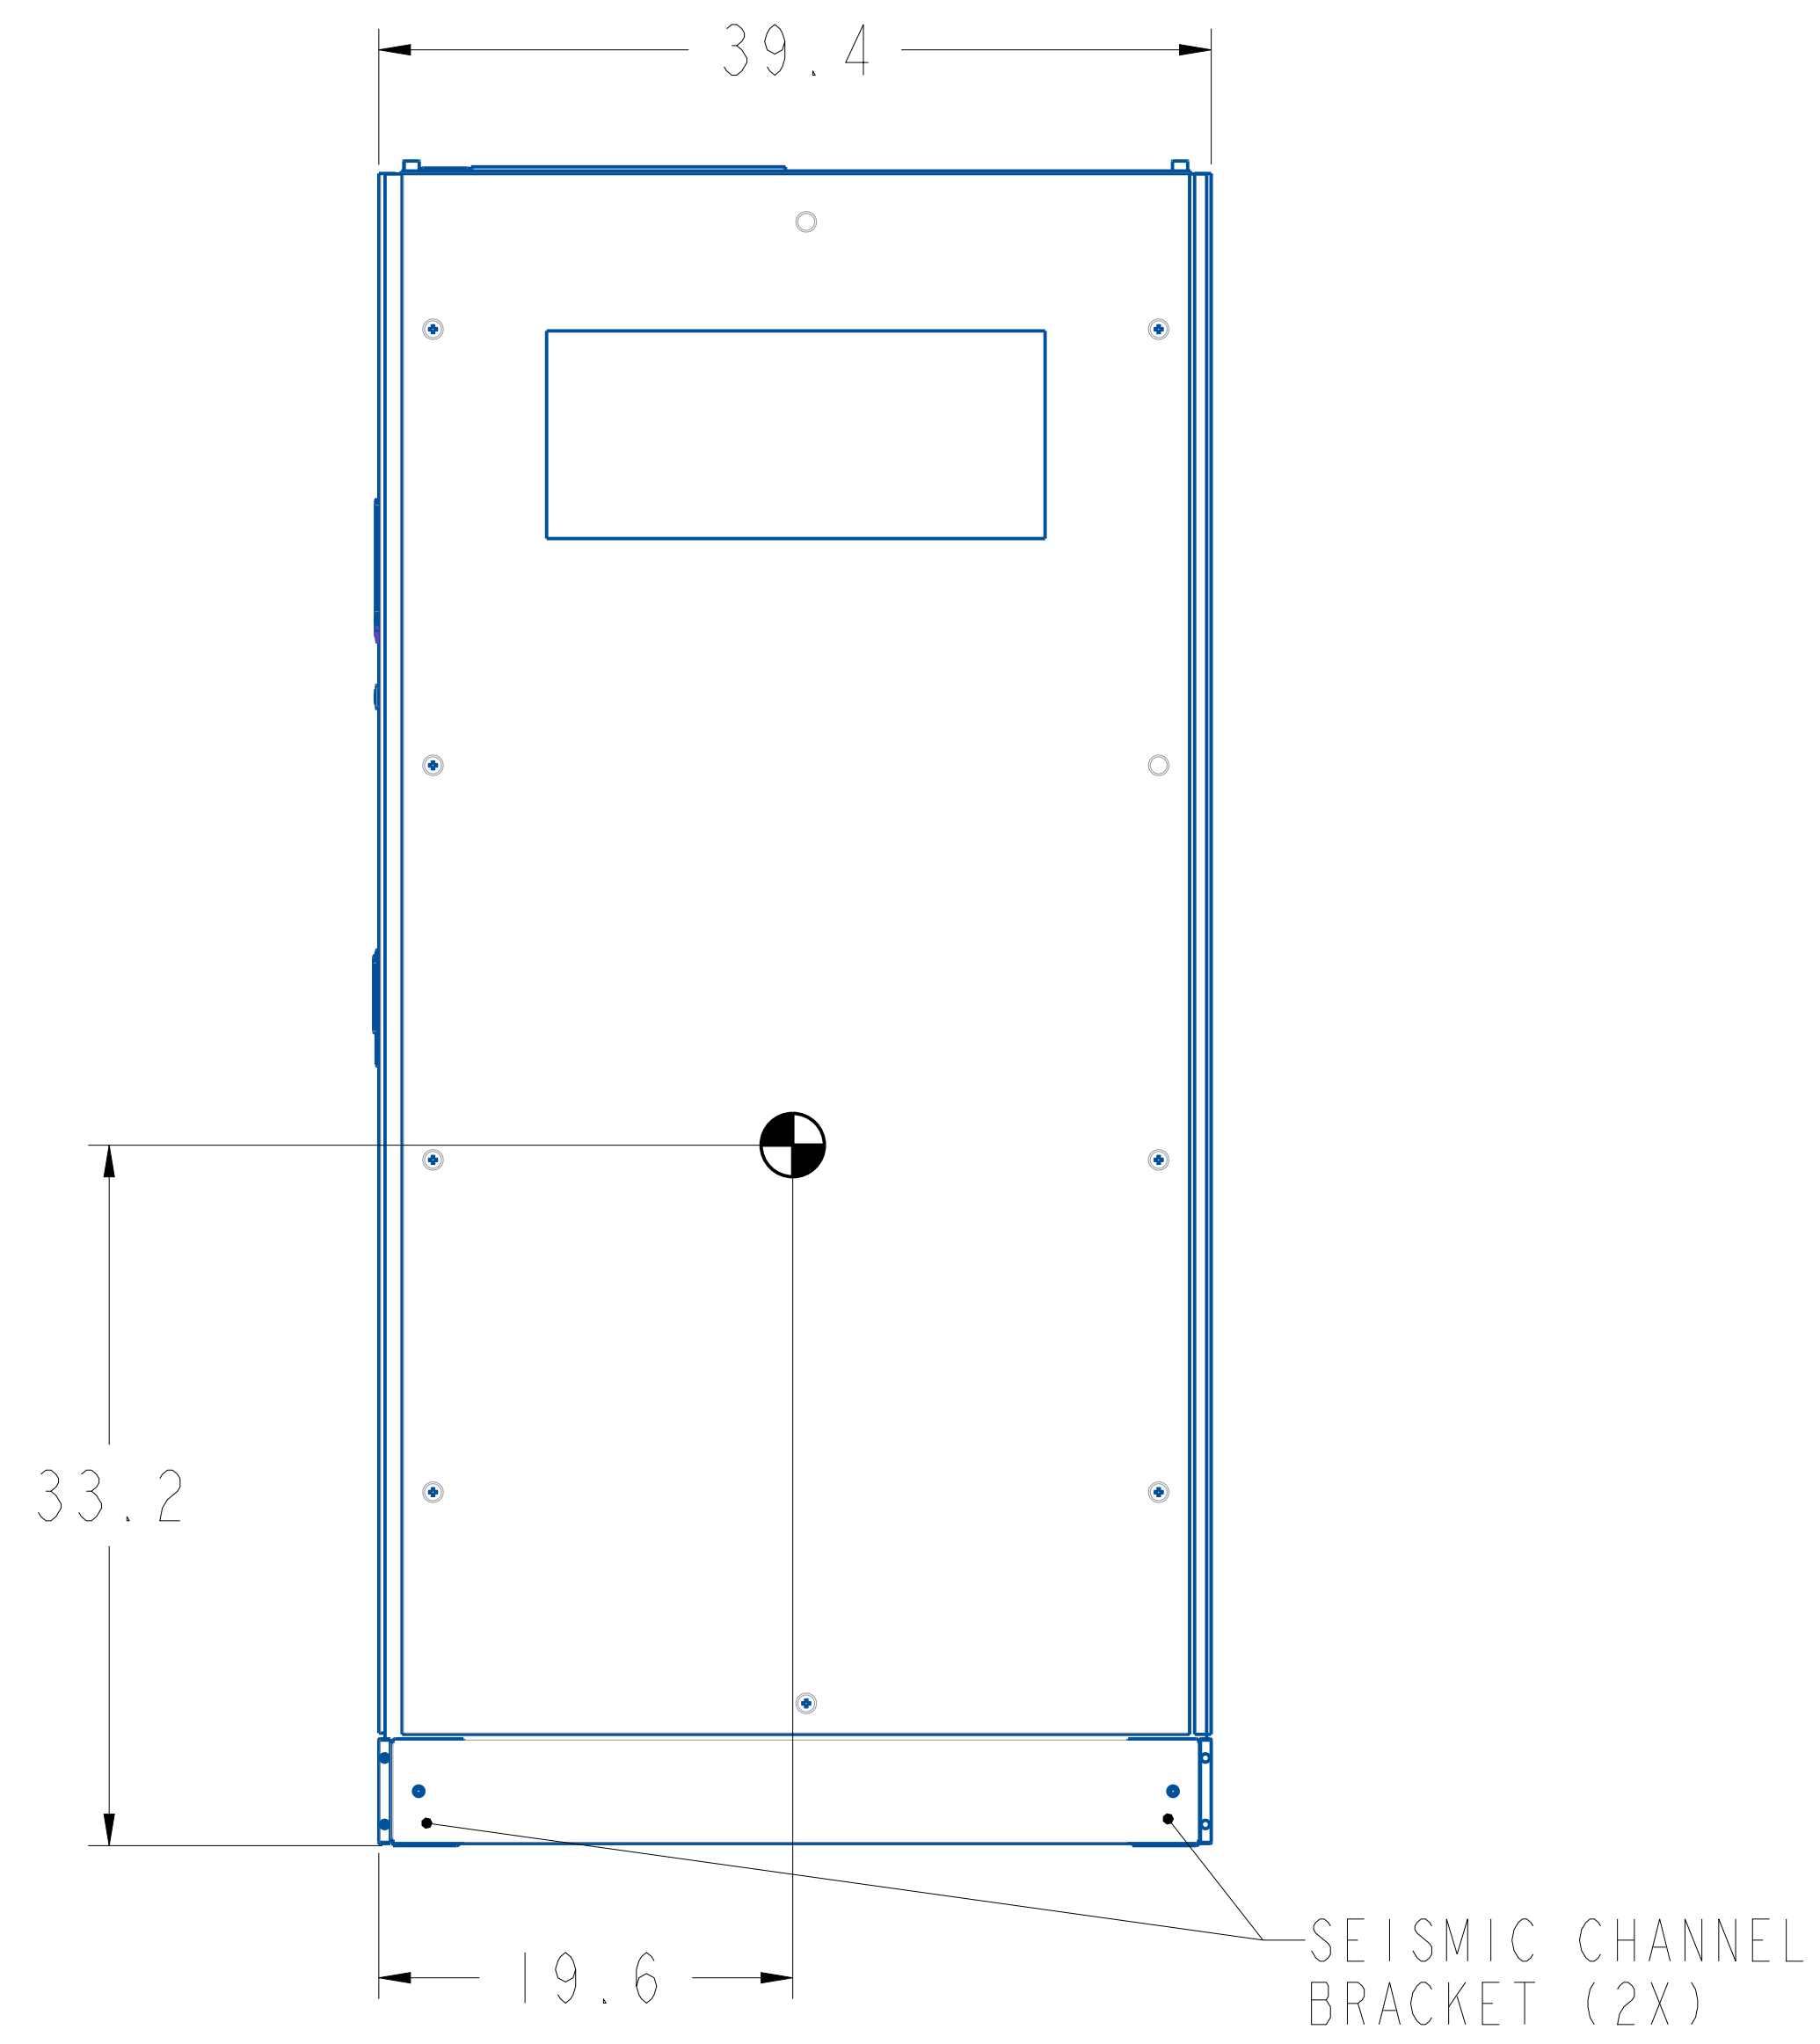


NXT POWER VANGUARD XL  
 NPU 80.0kVA - 200.0kVA

⊕ - CENTER OF GRAVITY  
 UNIT WEIGHT: 1035 LBS MAX

REV	ECN	CHANGE DESCRIPTION	ENGINEER	DATE	APPROVED
A		FOR RELEASE	BRO	Jun-08-26	

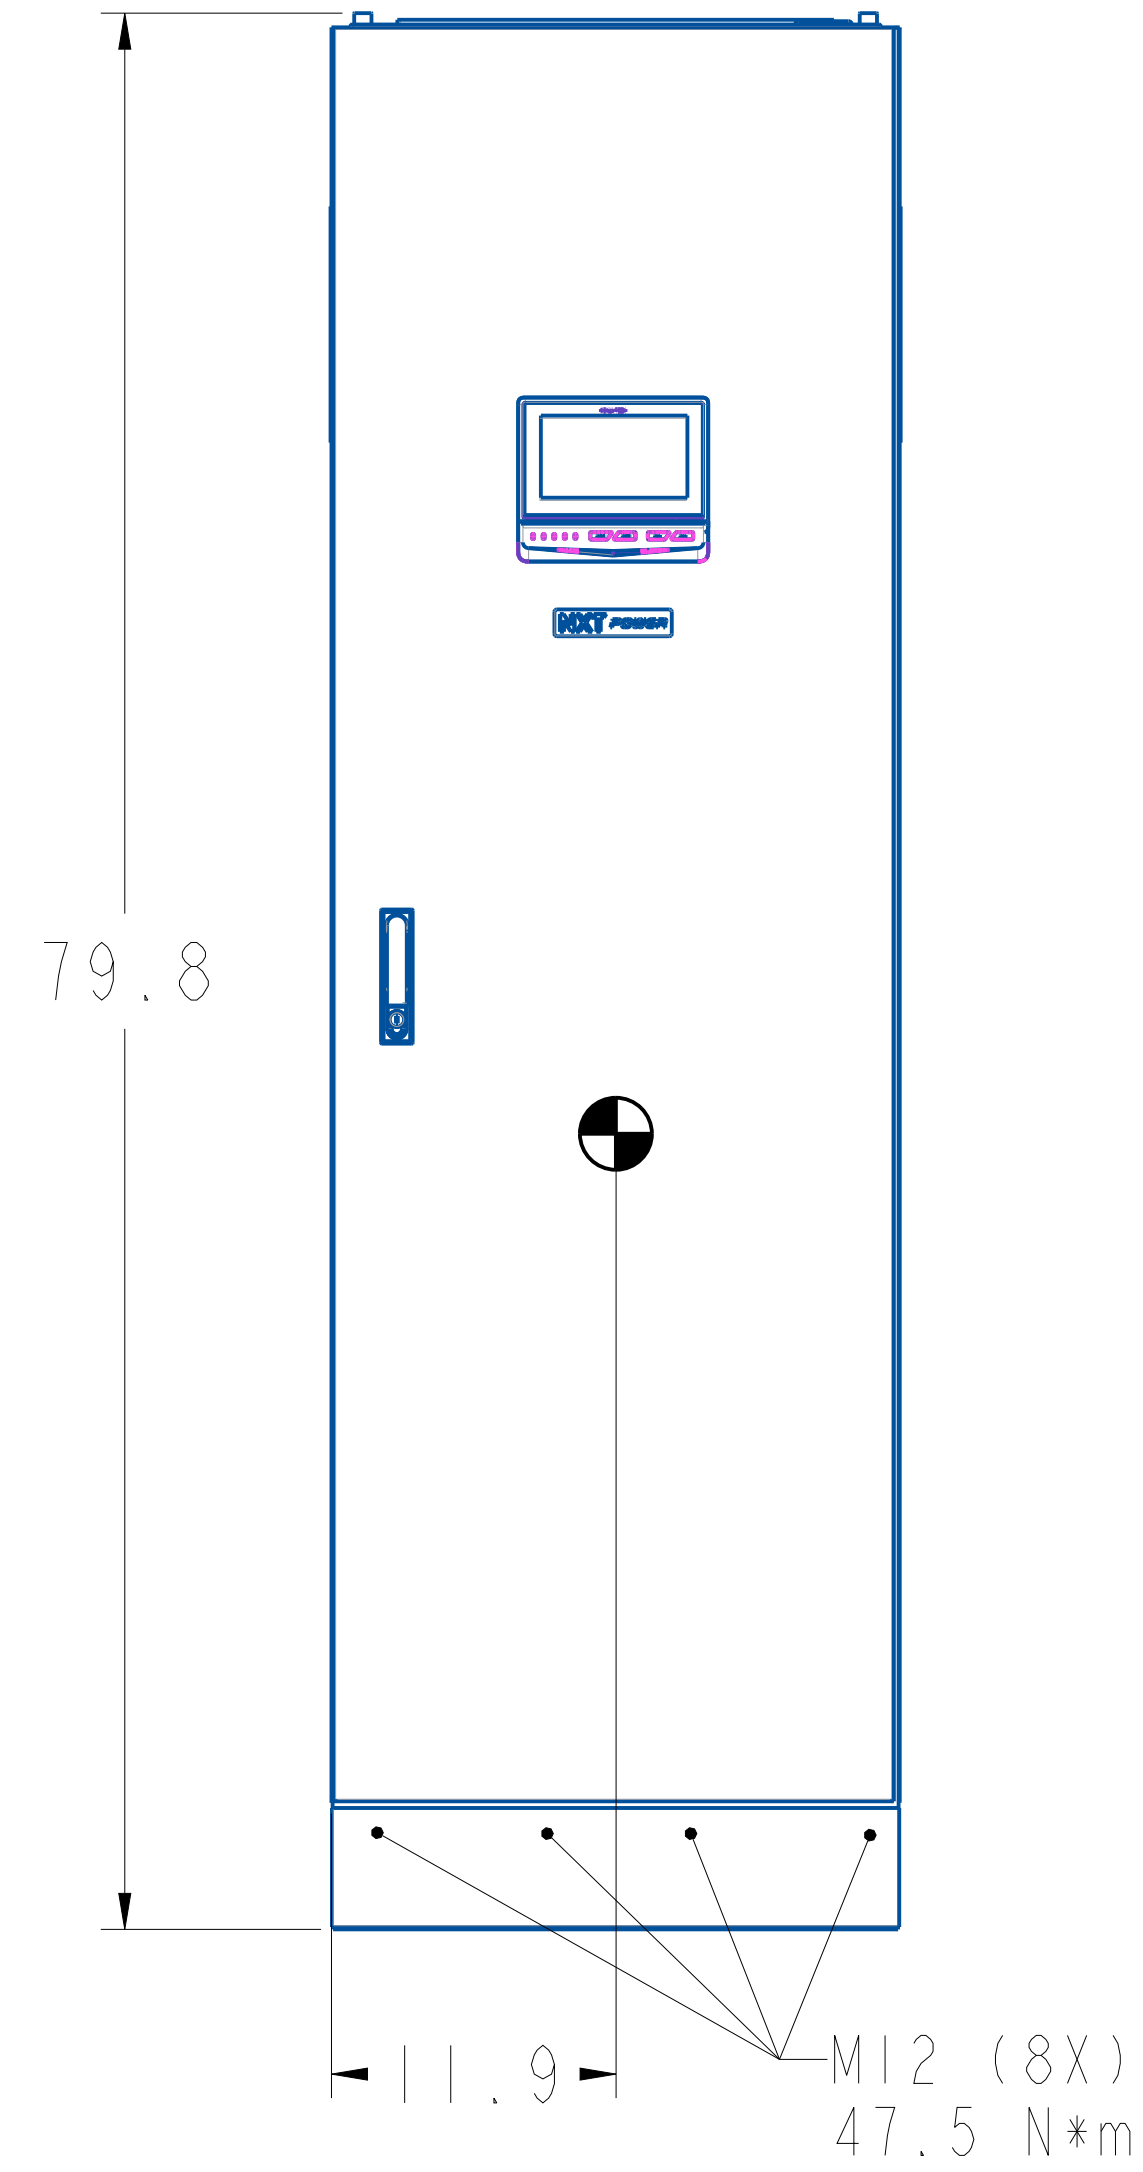

\*HOLE MOUNTING POSITION ON THE GROUND (INCH)

UNLESS OTHERWISE SPECIFIED  
 DIMENSIONS ARE IN DECIMAL INCHES  
 TOLERANCES  
 ANGULAR: MACHINED ±0.5° BEND ± 1°  
 ONE PLACE DECIMAL: ±.03  
 TWO PLACE DECIMAL: ±.010  
 THREE PLACE DECIMAL: ±.005  
 BREAK SHARP EDGES: .01-.02R



NXT POWER PART NO. NPU200.0 O-HO-N		MATERIAL: NA	
DESCRIPTION: VANGUARD XL 200.0kVA SEISMIC ANCHOR SPECIFICATION		FINISH: NA	
INITIATOR: BRO	REVISION: A	SIZE: D	SCALE: 0.077
		PAGE: 1 of 2	


VANGUARD XL 3 PHASE UPS  
 NPU 80.0kVA - 200.0kVA  
 SEISMIC ANCHORAGE  
 SLAB ON GRADE

BOLT TORQUE SPEC:  
 47.5nM  
 UNIT WEIGHT 1035 LBS

VANGUARD XL 3 PHASE UPS SEISMIC ANCHORING INSTRUCTIONS:



- Step 1: Move the UPS from the pallet to the ground.  
 Step 2: Mark the positions of mounting holes on the ground.  
 Step 3: Install the expansion tubes of the M12 expansion bolts.
1. Drill 4x  $\varnothing$ 14mm holes on the ground by hammer drill.
  2. Tighten the expansion bolt slightly and place it vertically in the hole. Tap the expansion bolt with a rubber hammer until the expansion pipe is fully inserted into the hole.
  3. Tighten the expansion bolt.
  4. Unscrew nut and remove flat washer and spring washer.

REV	ECN	CHANGE DESCRIPTION	ENGINEER	DATE	APPROVED
A		FOR RELEASE	BRO	Jun-08-26	

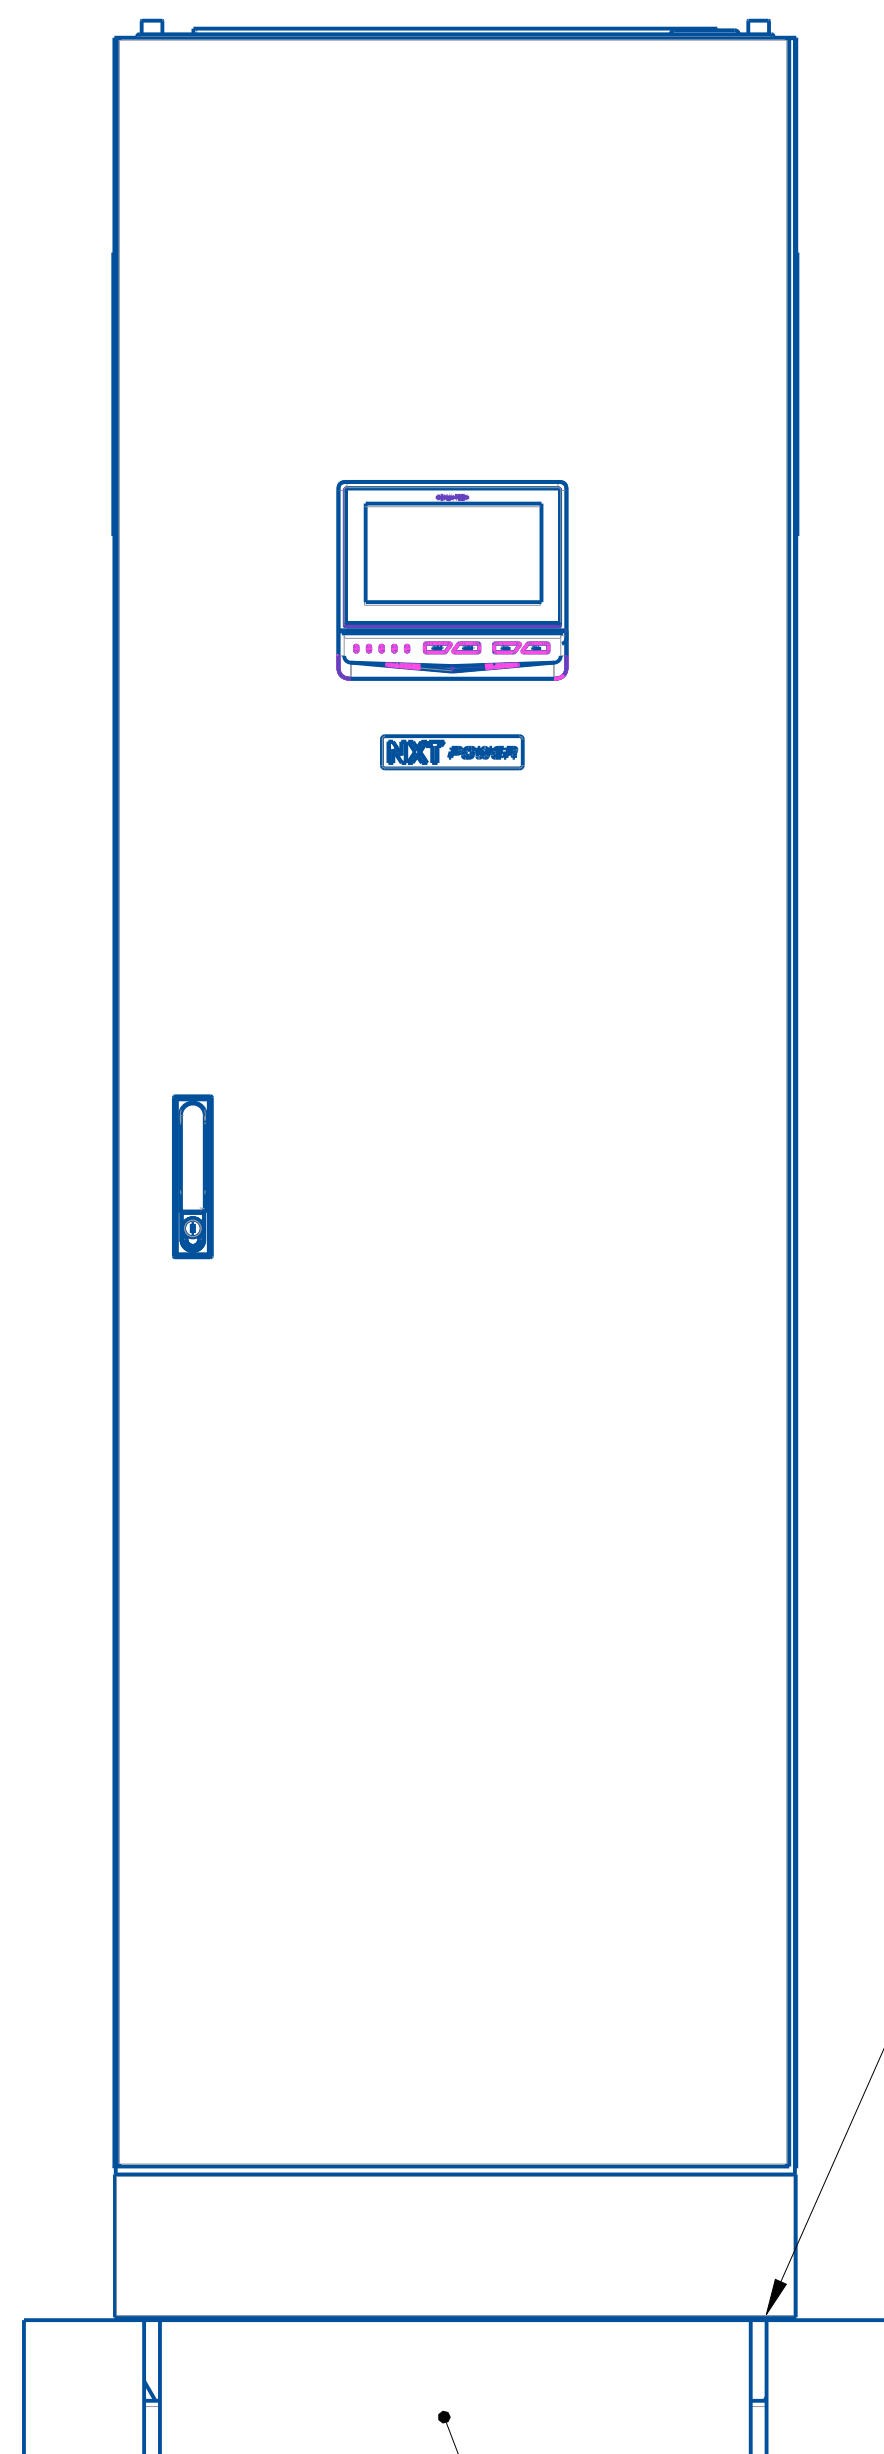


M12 EXPANSION ANCHOR  
 GRADE 8 (4X)  
 MINIMUM EMBED. 30-50MM (1.2")

NORMAL WEIGHT CONCRETE AT OR BELOW GRADE LEVEL

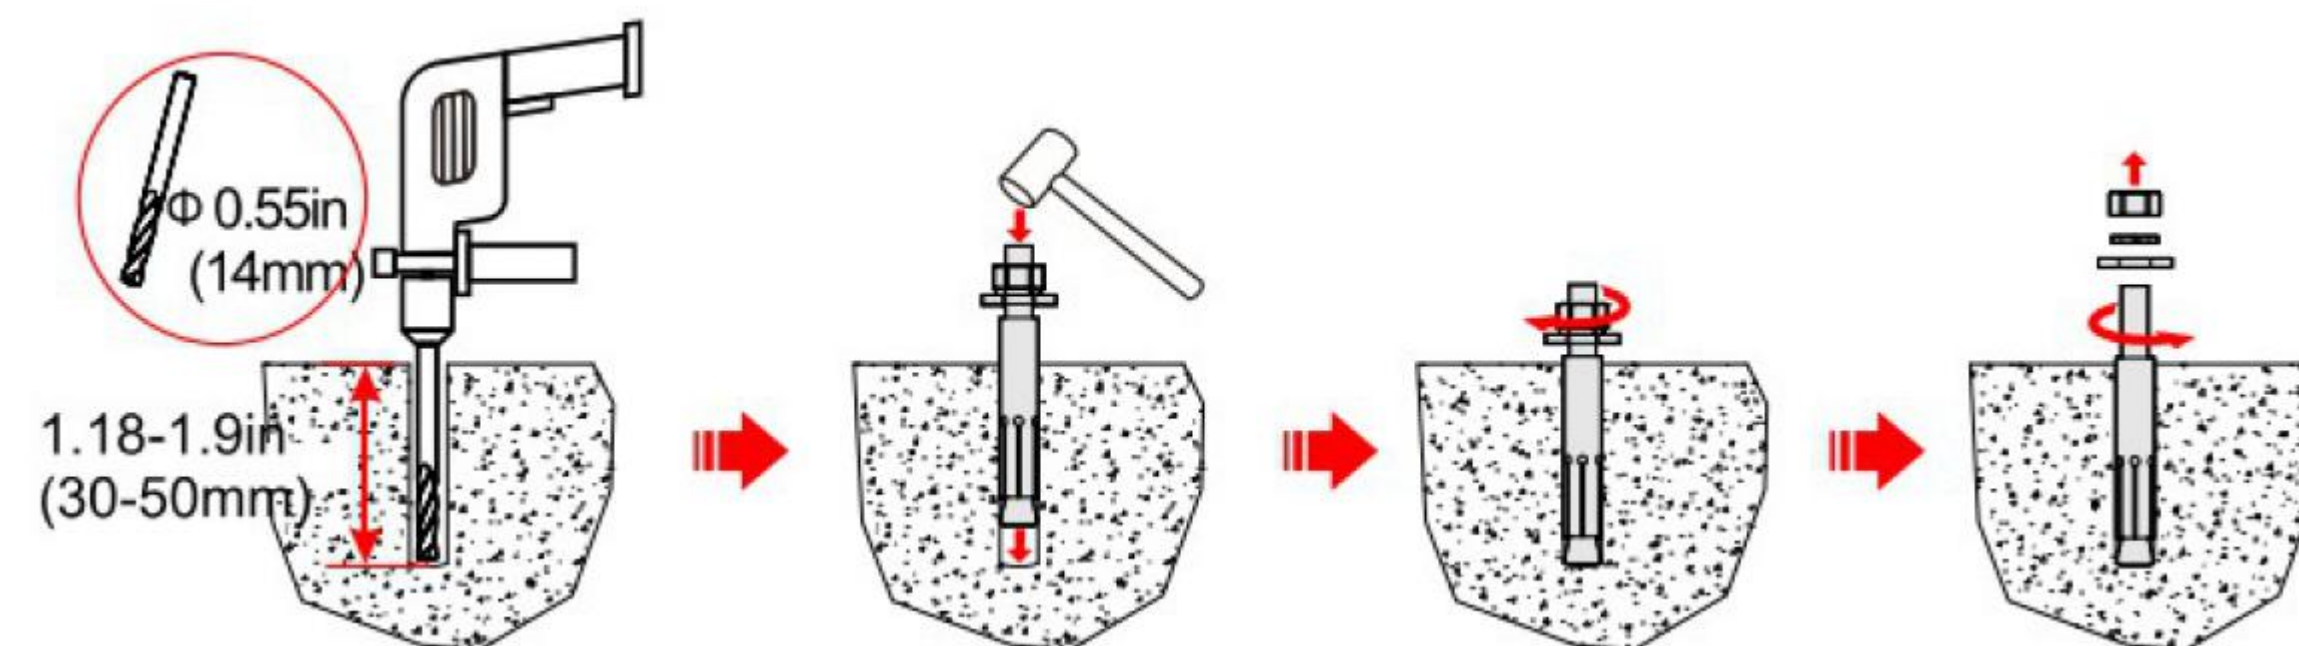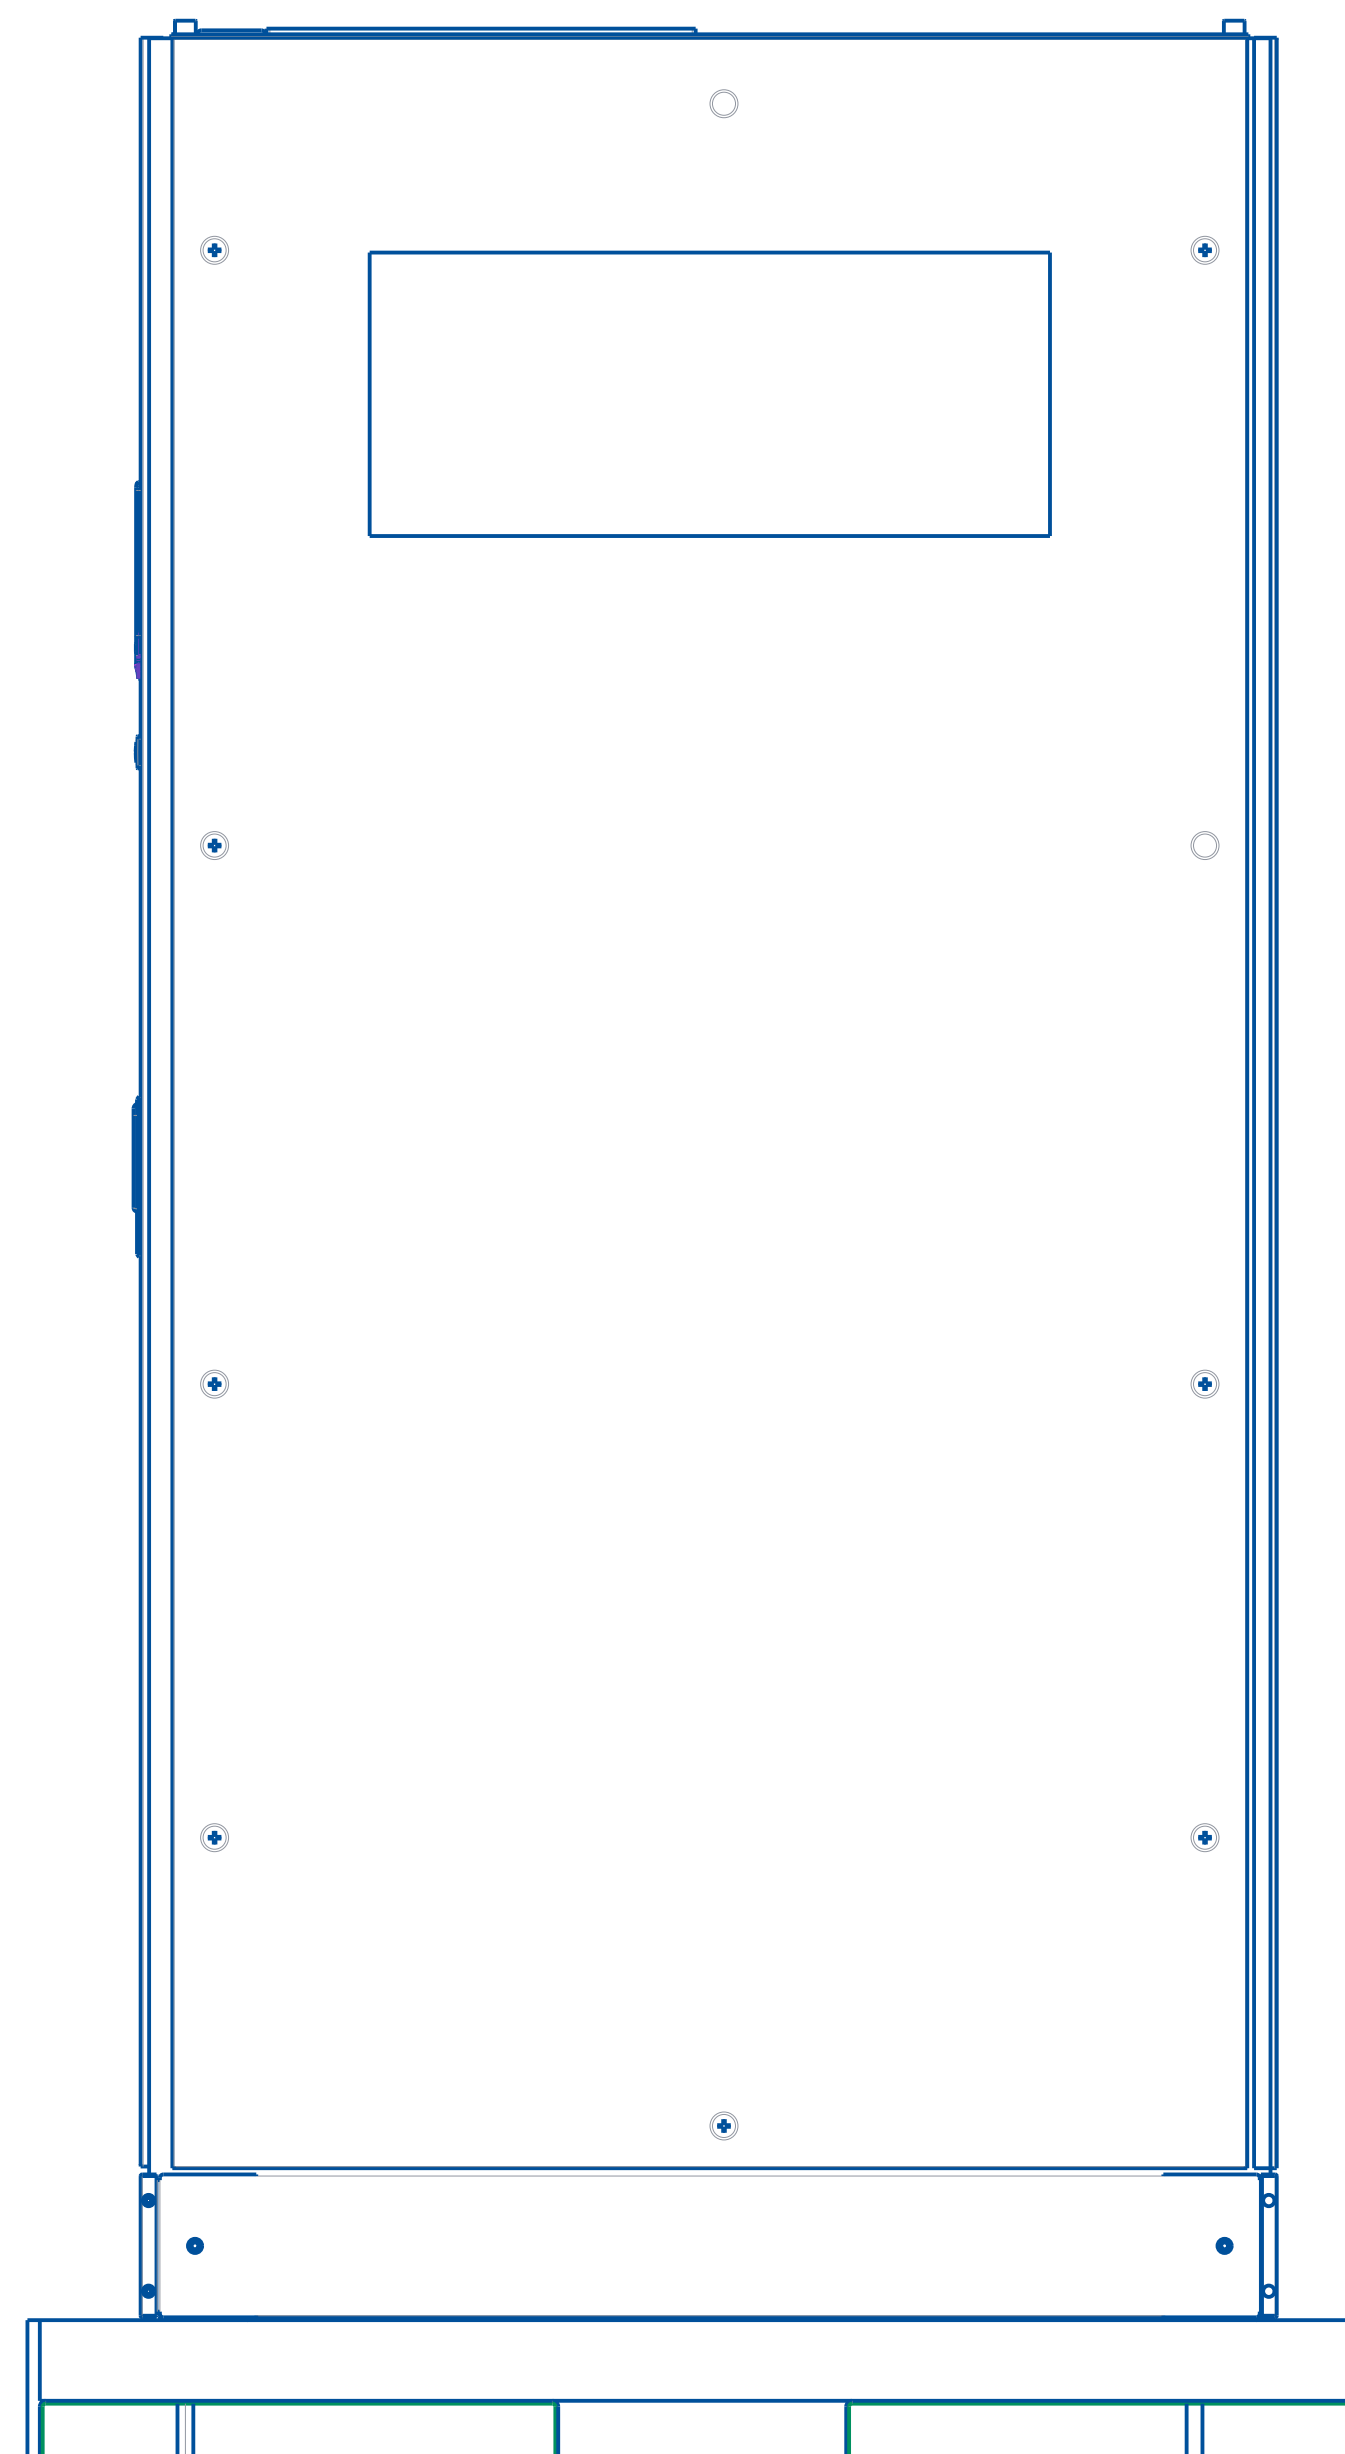

INSTALL THE EXPANSION TUBES.

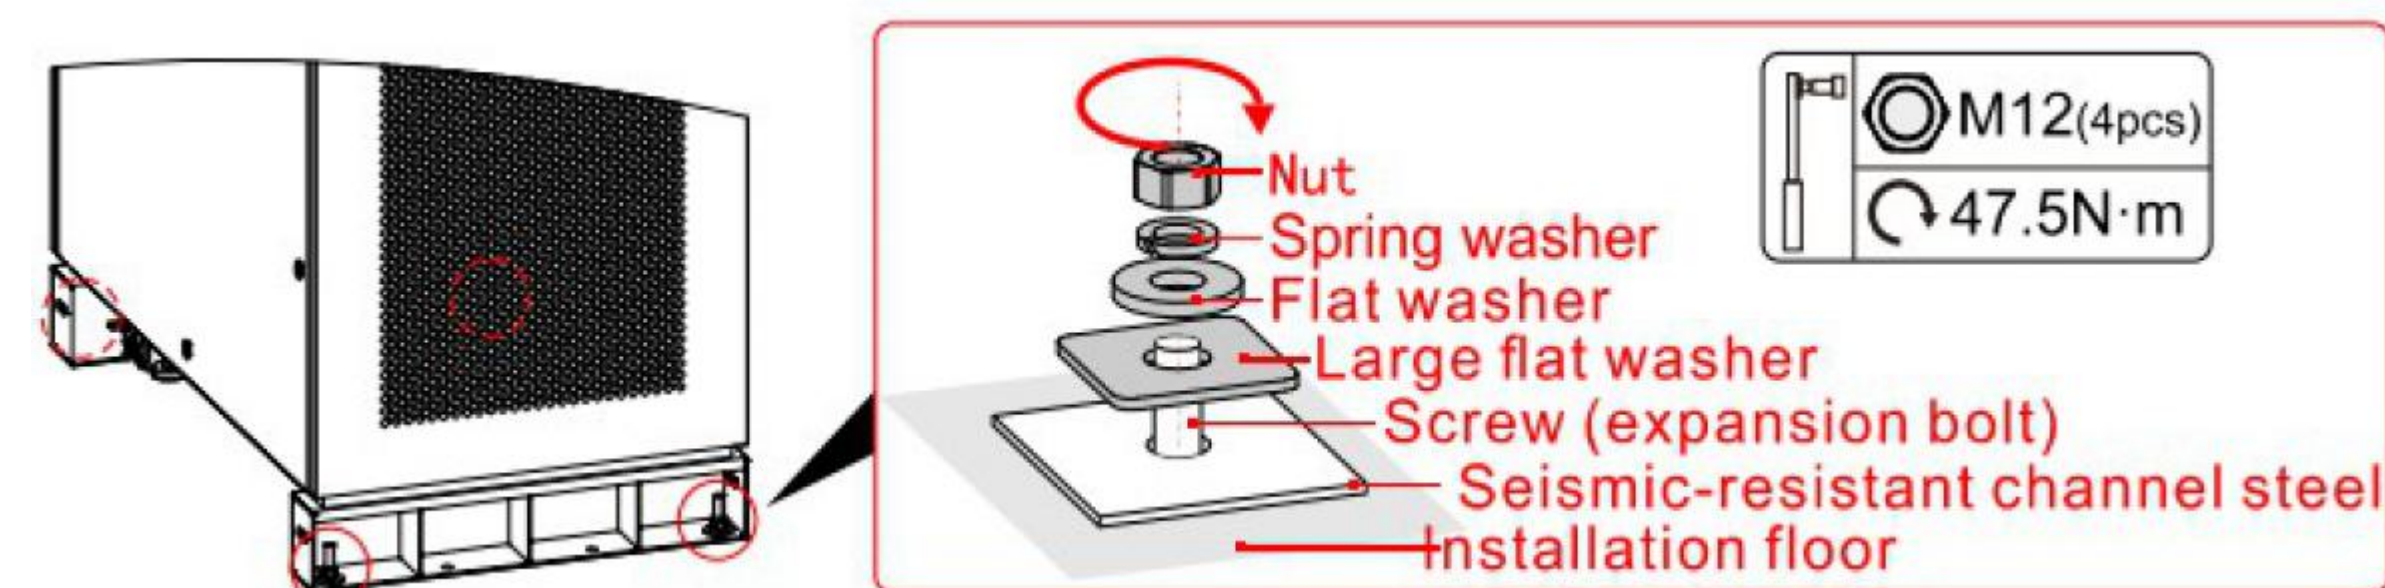

BOLT DOWN THE UPS

HOLE LEGEND				
HOLE	QUANTITY	SIZE	TOLERANCE	PEM
A		$\varnothing$	$\pm .010$	-

UNLESS OTHERWISE SPECIFIED  
 DIMENSIONS ARE IN DECIMAL INCHES  
 TOLERANCES  
 ANGULAR: MACHINED  $\pm 0.5^\circ$  BEND  $\pm 1^\circ$   
 ONE PLACE DECIMAL:  $\pm .03$   
 TWO PLACE DECIMAL:  $\pm .010$   
 THREE PLACE DECIMAL:  $\pm .005$   
 BREAK SHARP EDGES: .01-.02R

<b>NXT POWER</b>	
NXT POWER PART NO. NPU200.0 0-HO-N	MATERIAL: NA
DESCRIPTION: VANGUARD XL 200.0kVA SEISMIC ANCHOR SPECIFICATION	FINISH: NA
INITIATOR: BRO	REVISION: A
SIZE: D	SCALE: 0.007
PAGE: 2 of 2	