


# INTEGRITY MAX Battery Cabinet

## Product Specifications

<b>MODEL</b>		<b>NPB48-192</b>
<b>TYPEFORM</b>		Extended Runtime Battery Cabinet
<b>BATTERY</b>		
<b>BATTERY</b>	Voltage (VDC)	192 Nominal
	Battery	12V, High Rate, Valve Regulated Sealed Lead-Acid, Flame Retardant
	Quantity	48
	Charge Current (ADC)	3 Amps
	Backup Time	See Run Time Chart
<b>ENVIRONMENTAL</b>		
<b>ENVIRONMENTAL</b>	Temperature (°C)	Operating: -5 to 40 °C; Storage: -25 to 55 °C
	Altitude (m)	Operating: 1,000
	Humidity	5.0% to 90.0%, Non-Condensing
	Heat Dissipation (BTU/hr)	742
<b>AGENCIES</b>		
<b>AGENCIES</b>	Safety	UL1778 5 <sup>TH</sup> Edition cUL to CSA22.2 CE Marked
	RoHS	All Units are RoHS Compliant (where applicable)
<b>OTHER</b>		
<b>OTHER</b>	Unit Weight (lbs/kg)	402 / 182
	Shipping Weight (lbs/kg)	474 / 215
	Connection	3 Conductor, DC + Gnd, 6' (Included)

### Product Dimensions in Inches (mm)

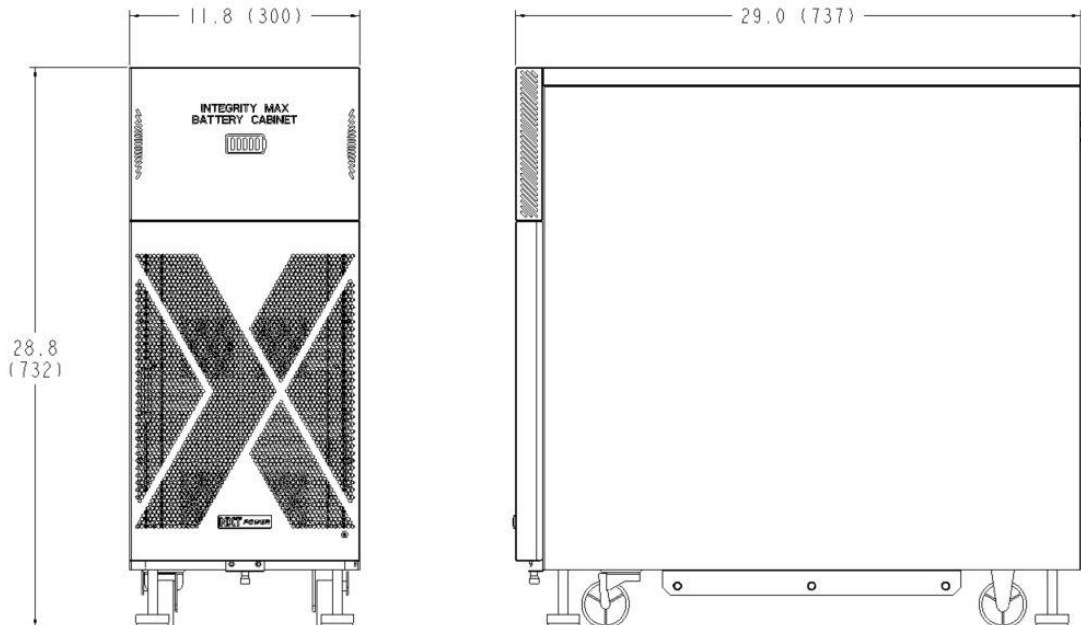

### Battery Backup Run Time Chart (UPS Internal Batteries + External Cabinets)

MODEL	# of Cabinets	Load =	25%	50%	75%	100%
			Hr : Min	Hr : Min	Hr : Min	Hr : Min
NPTU2200	1	Run Time =	9 : 50	4 : 38	2 : 53	2 : 02
	2	Run Time =	18 : 47	8 : 31	5 : 37	3 : 58
	3	Run Time =	28 : 18	13 : 20	8 : 05	6 : 05
	4	Run Time =	33 : 19	17 : 55	10 : 51	8 : 04
NPTU3200	1	Run Time =	6 : 44	2 : 58	1 : 50	1 : 19
	2	Run Time =	12 : 47	5 : 49	3 : 36	2 : 35
	3	Run Time =	18 : 33	8 : 22	4 : 49	3 : 53
	4	Run Time =	24 : 23	11 : 19	7 : 24	5 : 18
NPTU4200	1	Run Time =	4 : 55	2 : 10	1 : 20	0 : 54
	2	Run Time =	9 : 02	4 : 11	2 : 37	1 : 50
	3	Run Time =	14 : 11	5 : 40	3 : 57	2 : 31
	4	Run Time =	18 : 51	8 : 24	5 : 23	3 : 52
NPTU5200	1	Run Time =	3 : 48	1 : 41	1 : 0	0 : 41
	2	Run Time =	7 : 13	3 : 16	1 : 59	1 : 26
	3	Run Time =	10 : 39	4 : 57	3 : 04	2 : 12
	4	Run Time =	14 : 58	6 : 48	4 : 12	3 : 00
NPTU6000	1	Run Time =	3 : 40	1 : 36	0 : 57	0 : 39
	2	Run Time =	6 : 58	3 : 07	1 : 55	1 : 22
	3	Run Time =	10 : 04	4 : 45	2 : 56	2 : 05
	4	Run Time =	14 : 19	6 : 31	4 : 02	2 : 53
NPTU8200	1	Run Time =	2 : 14	0 : 56	5 : 30	0 : 23
	2	Run Time =	4 : 20	1 : 53	1 : 10	0 : 47
	3	Run Time =	6 : 34	2 : 54	1 : 47	1 : 16
	4	Run Time =	8 : 36	3 : 59	2 : 27	1 : 45
NPTU10.0	1	Run Time =	1 : 58	0 : 49	0 : 29	0 : 19
	2	Run Time =	3 : 52	1 : 42	1 : 01	0 : 42
	3	Run Time =	5 : 56	2 : 37	1 : 36	1 : 07
	4	Run Time =	7 : 54	3 : 33	2 : 10	1 : 34

Notes: Run-Times are in Hr : Min and based on new fully charged batteries at 25 deg C ambient.

### Warranty/Support

NXT Power warrants the components (including internal batteries) used in its uninterruptible power supplies to be free from defects in materials and workmanship for a period of three years from the date of shipment. See Warranty Statement for complete details. For North American service or support on any NXT Power product, please contact NXT Power at (877) NXT POWR (877-698-7697). In Illinois, call (872) 310-4056. To view the NXT Power Warranty Policy and Procedures, visit [www.nxtpower.com](http://www.nxtpower.com)