




STEP 1: INSTALL UNIT

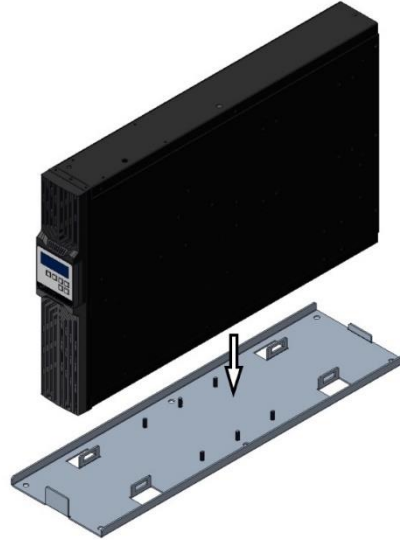


STEP 2: INSTALL 001-00137-01-FNL BAND AND ¼" NUTS (6X)

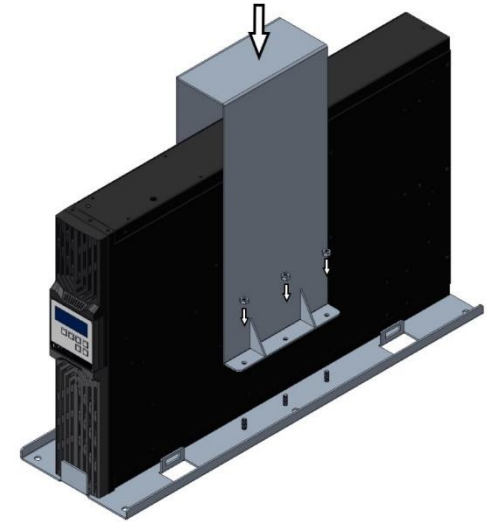

STEP 3: TIGHTEN ¼" NUTS 5NM TORQUE


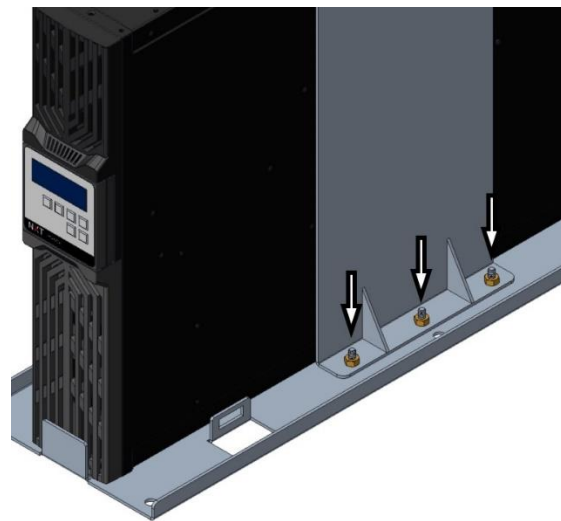


STEP 4: INSTALL UNIT TO FLOOR (REF TO FOLLOWING PAGES FOR DIMS AND BOLT SPEC.)

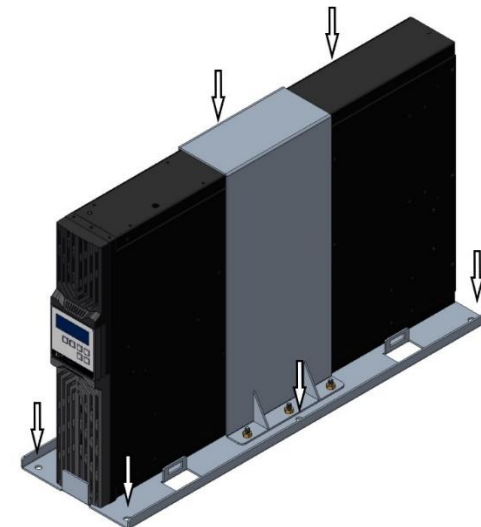

RT MOUNTING DIMENSIONS

HOLES FOR 3/8"-16 BOLT (6X)

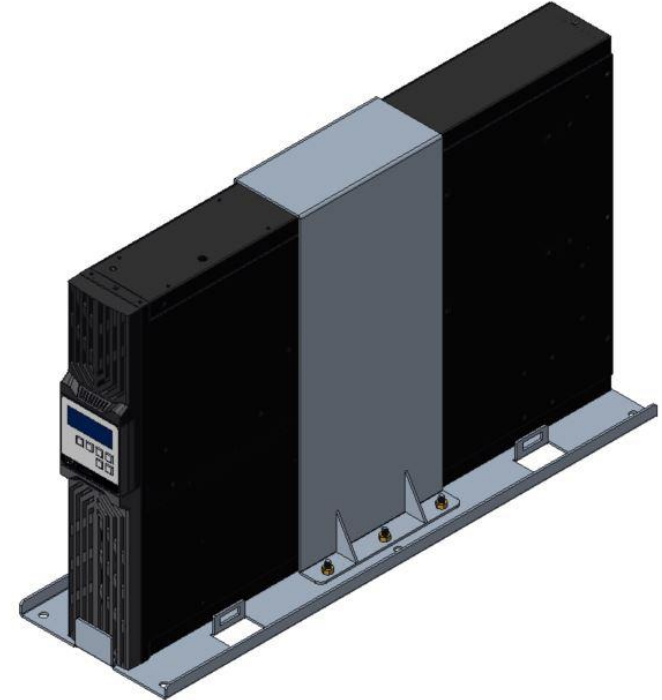
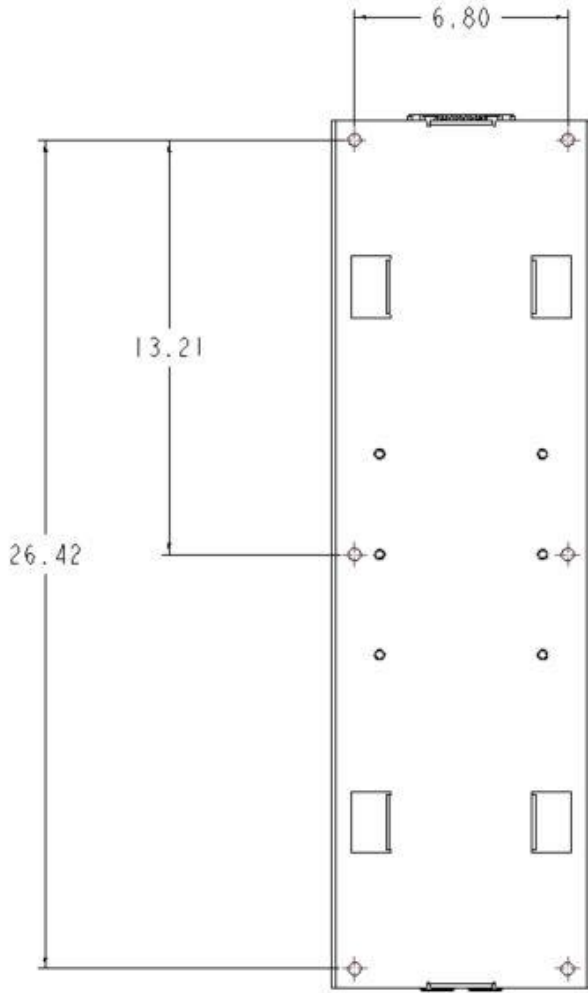


RT
SEISMIC ANCHORAGE
UPPER FLOOR

BOLT TORQUE SPEC:
3NM / 27 IN LBS
UNIT WEIGHT:

RT SEISMIC ANCHORING INSTRUCTIONS:

- 1) MOVE THE UPS TO THE INSTALLATION LOCATION
- 2) BOLT UPS SEISMIC ANCHOR. NXT PART NUMBER 001-00136-01-FNL TO THE FLOOR USING 3/8" GRADE 8 THREADED RODS (6X) AS DESCRIBED BELOW.

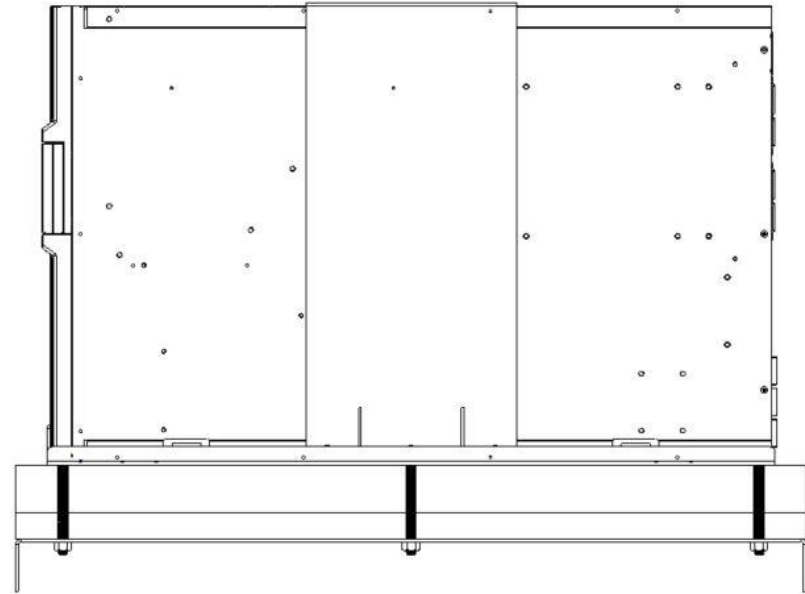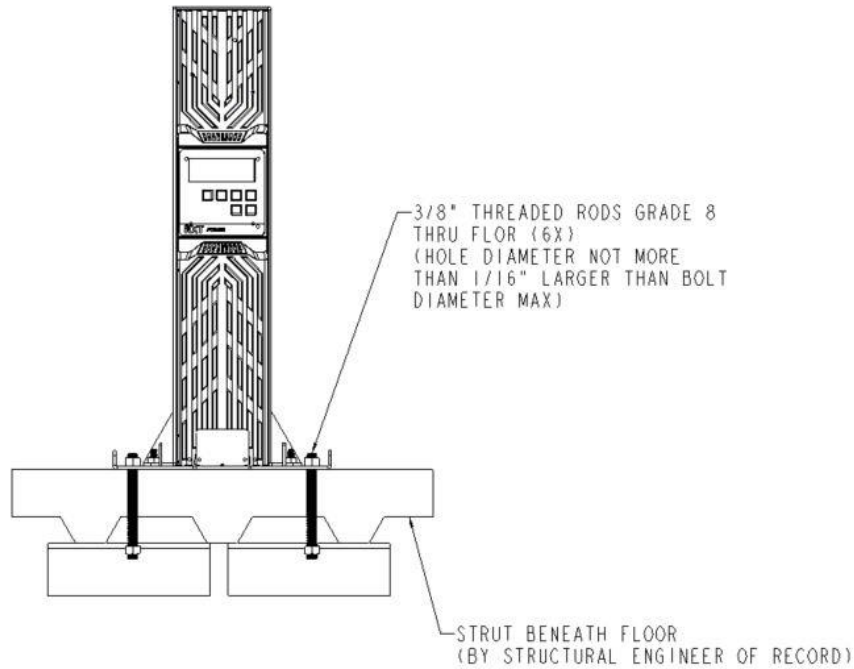

RT
SEISMIC ANCHORAGE
SLAB ON GRADE

BOLT TORQUE SPEC:
3NM / 27 IN LBS
UNIT WEIGHT:

RT SEISMIC ANCHORING INSTRUCTIONS:

- 1) MOVE THE UPS TO THE INSTALLATION LOCATION
- 2) BOLT UPS SEISMIC ANCHOR. NXT PART NUMBER 001-00136-01-FNL TO THE FLOOR USING 3/8" GRADE 8 EXPANSION ANCHORS (6X) FOR CONCRETE AS DESCRIBED BELOW.

